



Iddero VERSO Q

User manual

Version: 1.0

Doc.ref. 20260923-01



Contents

1	Introduction	5
1.1	Product overview	5
1.2	Connection	6
1.3	First boot	6
1.4	Programming mode	7
2	Functional description	8
2.1	Visualisation	8
2.1.1	Overview	8
2.1.2	Home page	10
2.1.3	Menu page	10
2.1.4	Control pages	11
2.1.5	Favorites page	13
2.1.6	Settings pages	13
2.1.7	Page layout	16
2.1.8	Access control	19
2.1.9	Power saving mode	19
2.1.10	Touch gestures	20
2.2	Time schedules	21
2.2.1	Overview	21
2.2.2	Timer groups	21
2.2.3	Editing of timer programs	22
2.2.4	Operation when the date and time are unknown	23
2.3	Alarms	23
2.3.1	Overview	23
2.3.2	Alarm visualisation	25
2.4	Thermostats	25
2.4.1	Overview	25
2.4.2	Room temperature	26
2.4.3	Setpoints	26
2.4.4	Heating and Cooling	30

2.4.5	Control algorithms	32
2.4.6	Additional heating and cooling	37
2.5	Multifunction inputs	37
2.5.1	Binary inputs	38
2.5.2	Temperature probe inputs	39
3	Configuration	40
3.1	General considerations	40
3.2	Main	41
3.2.1	General	41
3.2.2	Internal temperature sensor	42
3.2.3	Timer groups	42
3.3	User Interface	43
3.3.1	General	43
3.3.2	Power saving mode	45
3.3.3	Access control	46
3.3.4	Main menu	47
3.3.5	Settings pages	47
3.3.6	Favorites	48
3.3.7	Touch gestures	48
3.4	Control Pages	49
3.4.1	General	49
3.4.2	Components	52
3.4.3	Timer function	73
3.5	Thermostats	75
3.5.1	General	75
3.5.2	Room Temperature	77
3.5.3	Setpoints	78
3.5.4	Operating Modes	79
3.5.5	Heating	80
3.5.6	Cooling	82
3.5.7	Simplified configuration mode	82
3.6	Inputs	83
3.6.1	General	83
3.6.2	Binary - Push button	83
3.6.3	Binary - Switch	85
3.6.4	Temperature probe	86
4	Advanced topics	87

4.1	Product customisation	87
4.1.1	Background images	87
4.1.2	Custom languages	88
4.2	Firmware updates	88
5	Annex	89
5.1	Communication Objects	89

Introduction

1.1 Product overview


Iddero VERSO Q is a 3.5" KNX capacitive touch panel for individual room control. It is available in white or black GLASS finish.

Function highlights:

- Up to 36 control functions, organized in 6 configurable pages
- User editable favorites page
- Custom background images
- Weekly time schedules: up to 36 channels, 4 programs / channel
- Alarm monitoring: up to 36 alarms
- Touch gestures: Up to 5 quick actions without leaving power saving mode
- Two independent thermostats
- Four multi-function inputs, individually configurable as binary or temperature probe inputs
- Built-in temperature sensor
- Integrated KNX bus coupling unit
- Ultra-low power consumption

1.2 Connection

The following figure shows connectors and other elements on the back of the product.

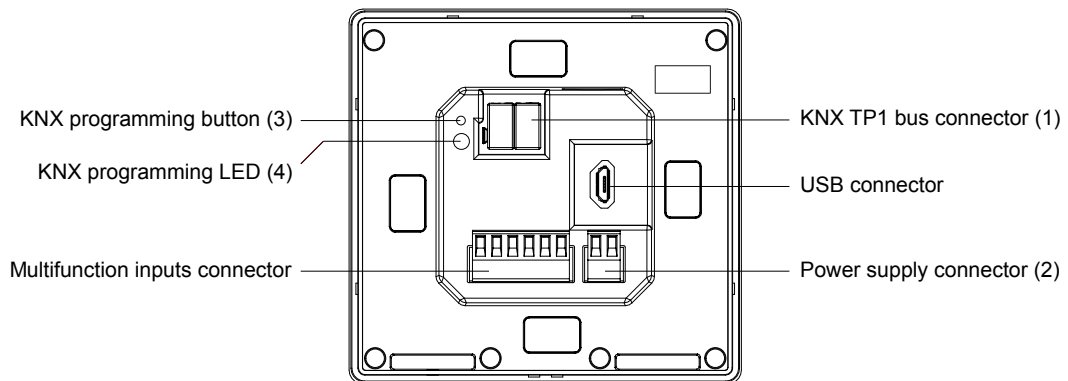


In order to bring up the device, connect the KNX bus to the KNX TP1 connector (1), and a separate power supply (12-30 VDC) to the power supply connector (2). Please refer to the product datasheet for detailed information on the power supply requirements.

Note

Do not connect the KNX bus directly to the power supply connector (2); a separate power supply is required.

1.3 First boot

As soon as the power supply is connected, the device will boot. Within a few seconds, the Iddero logo will appear on the screen. Then, the Synchronisation page will be shown.

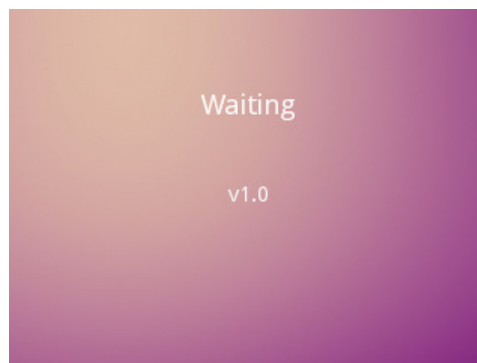

The Synchronisation page will remain onscreen as long as the device has not yet been programmed with application data from ETS. This page is also displayed if the KNX bus is disconnected, or while the device is being reprogrammed.

If the KNX bus is connected and the device has already been programmed, the Synchronisation page will disappear and the Home page will be shown automatically.

After startup, the date and time are unknown. Time schedules will not run until the date and time are available, either received from the KNX bus or set manually from the settings menu. Please refer to [2.2 Time schedules](#) on page 21 for more information.

1.4 Programming mode


In order to put the device in programming mode, press the KNX programming button (3). While the device is in programming mode, the KNX programming LED (4) will be on.

Functional description


2.1 Visualisation

2.1.1 Overview

The VERSO Q user interface is organized into pages. This includes both configurable function pages (also called “control pages”) and fixed function pages, such as the Menu or settings pages. The following diagram provides a high level view of the navigation structure:

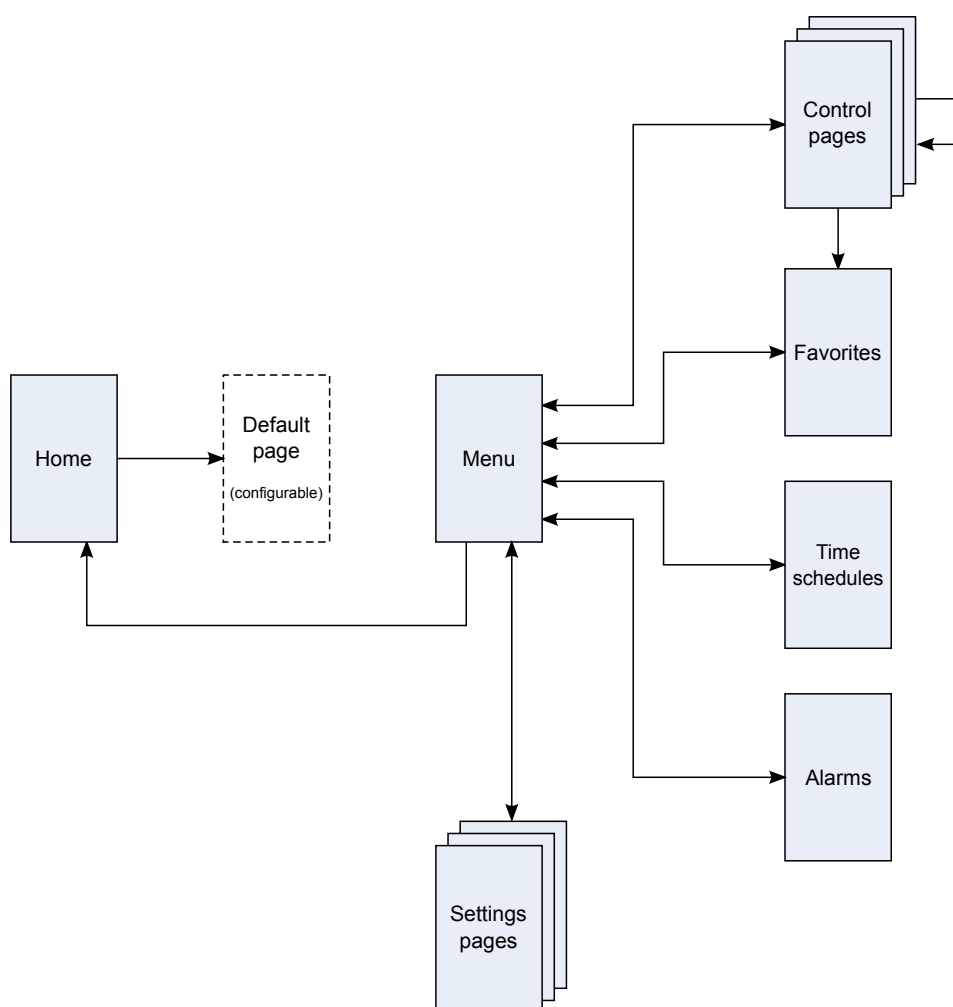

The following screenshot shows the main elements of the user interface:

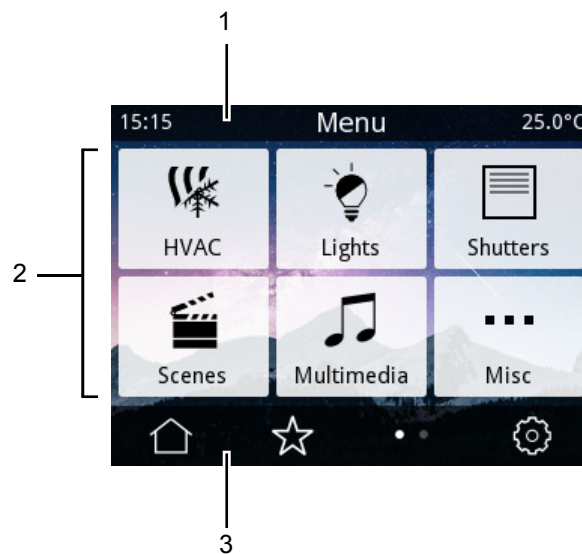


The status bar (1) at the top of the screen shows the name of the current page, and, optionally, the current time and temperature.

The main area of the screen (2) shows the icons, buttons, and user interface elements relative to the current menu or function page.

The navigation bar (3) at the bottom of the screen shows icons to navigate through the user interface. The set of displayed icons will depend on the available navigation options in each page; these are summarized in the following table:


Icon	Function
	Go to the Menu page. If already in the Menu page, exit to Home page.
	Return (go back one step)
	Go to the Favorites page
	Go to the settings pages
	In the Menu page: switch between control pages and time schedules/alarms
	In control pages: go to previous control page
	In control pages: go to next control page

2.1.2 Home page

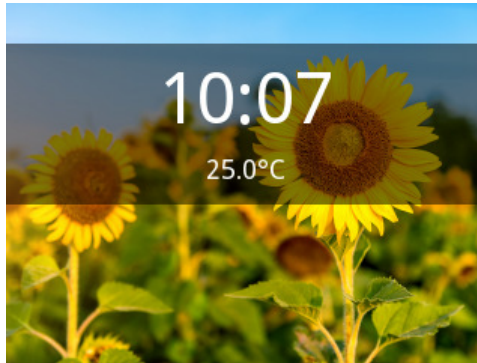

Upon startup, the Home page is shown automatically. The Home page can be configured to show the current date and time, and also the current temperature. Tapping anywhere on the screen will automatically switch to the “default page”. The “default page” can be the Menu page, the Favorites page, or any of the configured control pages.


2.1.3 Menu page

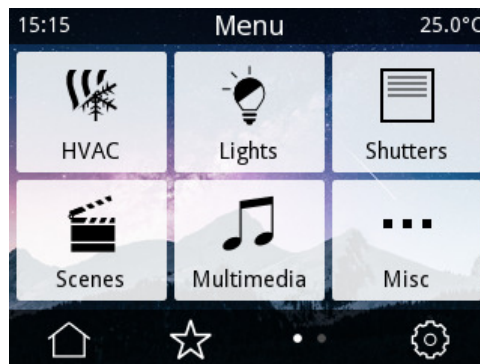

The Menu page provides quick and easy access to all pages in the visualisation, including:

- Any of the configured control pages
- The time schedules pages
- The alarms pages
- The Favorites page
- The settings pages

The time schedules and alarms pages, when available, are shown in the two rightmost positions of the Menu page: the time schedules page in the position corresponding to control page 3, and the alarms page in the position corresponding to control page 6.

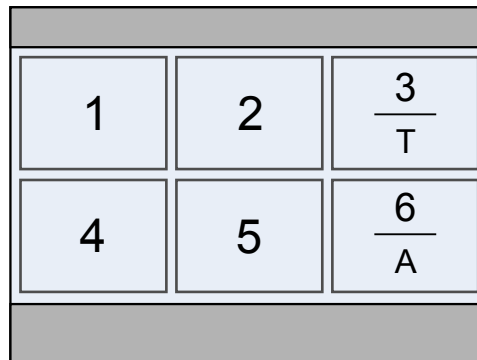


If any of these positions is already occupied by the corresponding control page, a second menu page is enabled specifically to show the time schedules and/or alarms pages. In that case, the “dots” icon (••) can be used to switch between the two menu pages.

2.1.4 Control pages

Control pages can be of two types: regular control pages and thermostat pages.

2.1.4.1 Regular control pages

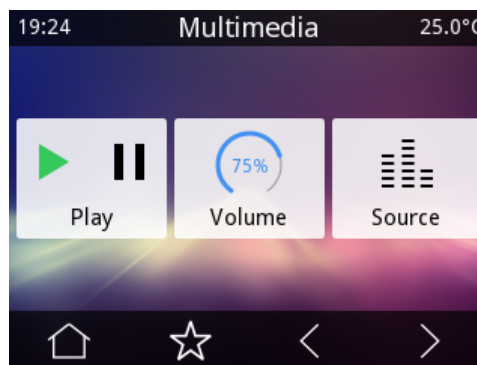

Regular control pages contain up to 6 configurable widgets, known as “components”. Available component types include the following:


- Indicators

- Indicators with alarm function
- Push buttons
- Double push buttons
- Regulation bars
- Rotary controls
- Numeric keypads
- Dimmer controls
- Shutter controls
- RGB and RGBW controls

These are described in detail in section [3.4.2 Components](#) on page 52.

For most component types, a timer function can be enabled. See [2.2 Time schedules](#) on page 21.

2.1.4.2 Thermostat pages

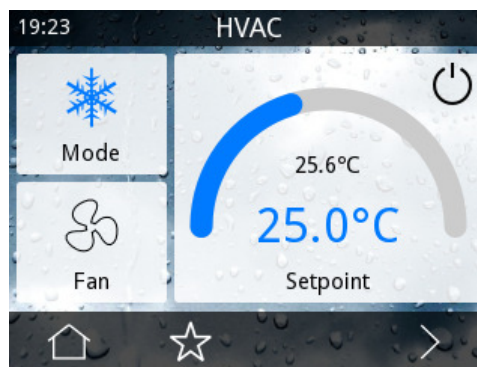

Thermostat pages show a setpoint control in their central area, which allows adjusting the temperature setpoint of a thermostat and, optionally, switching it on and off. Up to two additional components can be shown next to the setpoint control, of any of the types listed for regular control pages.

The setpoint control also supports the timer function.

2.1.5 Favorites page

A “favorites” page allows end users to select up to six commonly used components for quick access¹; see [2.1.6.4 Edit favorites page](#) on page 16. The Favorites page can be reached from the Menu page or from any of the control pages.

2.1.6 Settings pages

The settings pages allow end users to configure certain device functions, as well as user interface preferences.

2.1.6.1 Main settings menu



The following buttons are available in this page:

- *Preferences*: Opens the Preferences page. See [2.1.6.2 Preferences page](#) on page 14.
- *System*: Opens the System Settings page. See [2.1.6.3 System settings page](#) on page 15.
- *Favorites*: Opens the Edit Favorites page. See [2.1.6.4 Edit favorites page](#) on page 16.
- *Clean screen*: Temporarily disables the touch screen for cleaning. Use a soft cloth to clean the screen. Do not use abrasive cleaners or detergents.

¹ Setpoint controls cannot be added to the Favorites page.


2.1.6.2 Preferences page



The following buttons are available in this page:

- *Date & time*: Allows setting the system date and time.
- *Language*: Allows selecting the user interface language.
- *Display*: Provides access to the following display settings:
 - *Brightness*: Allows adjusting the brightness of the display.
 - *Theme*: Allows selecting light or dark mode.
 - *Power saving*: Allows configuring the inactivity timeouts used for power saving mode. See [2.1.9 Power saving mode](#) on page 19
- *Buzzer*: By default, the screen will beep when the user touches a user interface element. The screen also beeps with different tones when a touch gesture is detected, and when an alarm triggers. This menu allows disabling some or all of these sounds.
- *Passwords*: Allows setting the user and/or master passwords. See [2.1.8 Access control](#) on page 19.

2.1.6.3 System settings page

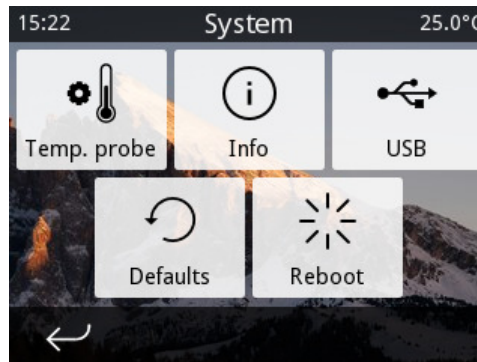

The following buttons are available in this page:

- *Temperature probe*: Allows adjusting the calibration offsets for enabled temperature probes (both the internal temperature sensor and any temperature probe connected to the device's multi-function inputs). The calibration offset is added to the temperature measured by the probe in order to compensate for the effect of local heat sources or air drafts that might affect the measurement.

Note


After a cold start, the internal temperature sensor may take several minutes to stabilise and provide reliable readings.

For accurate calibration of the offset, it is recommended that the device has been installed in its final location and running for at least one hour.

- *Info*: Shows information about the device and the configuration. The following information will be shown:
 - Project name, if parametrized in ETS
 - Firmware and application program version
 - Serial number of the device
 - Current KNX address
- *USB*: Allows advanced customisation options. See [4.1 Product customisation](#) on page 87.
- *Defaults*: Resets all settings to default values. Any user configuration will be discarded, including preferences, timer schedules, etc. The device will be left in the same state as if it had been just programmed from ETS. Note: The following settings are not affected by this option:

- Current date and time
- Display brightness
- *Reboot*: Reboots the device.


2.1.6.4 Edit favorites page

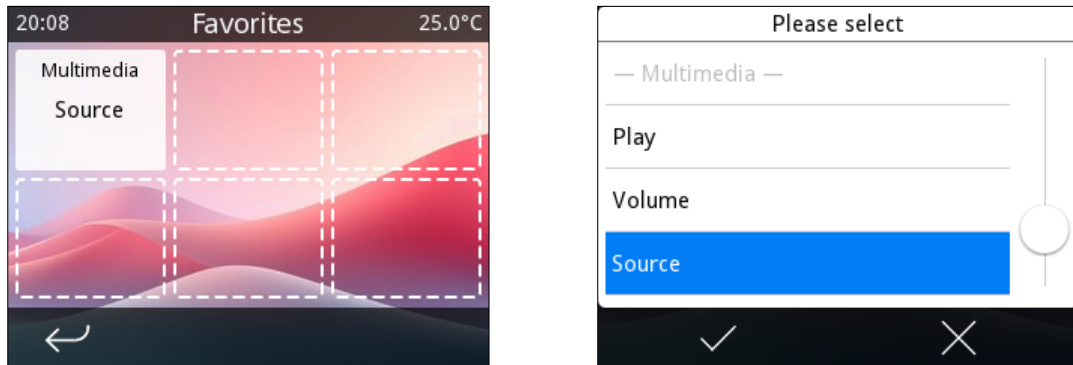

This page allows end users to select up to six components that will be shown in the Favorites page. A grid with six positions will be shown. Touching any of the elements in the grid shows a list of available components. The special list entry “[None]” can also be selected in order to clear the corresponding position in the grid.

2.1.7 Page layout


Many of the pages in the user interface are arranged as a grid that can contain up to 6 elements. The position of each element in the grid is shown in the following figure:

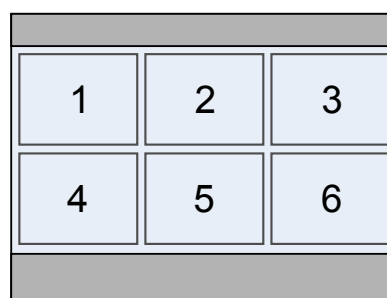

For certain pages, including the Menu page, the configurable control pages (except thermostat pages), and the Favorites page, several layout options are available.

- *Fixed positions*: Each element is displayed in its natural position in the grid.
- *Flexible – center*: Each row is horizontally centered. Empty rows are skipped; any remaining rows are then vertically centered.
- *Flexible – center + stretch horizontally*: Similar to *flexible – center*, but all rows are horizontally stretched to fill the available screen width.
- *Flexible – center + stretch vertically*: Similar to *flexible – center*, but all rows are vertically stretched to fill the available screen height.
- *Flexible – center + stretch in both directions*: Similar to *flexible – center*, but all rows are horizontally stretched to fill the available screen width, then vertically stretched to fill the available screen height.

The following figure shows the resulting layout for each option in a grid where positions 1 and 2 have been used, with all other positions left empty.

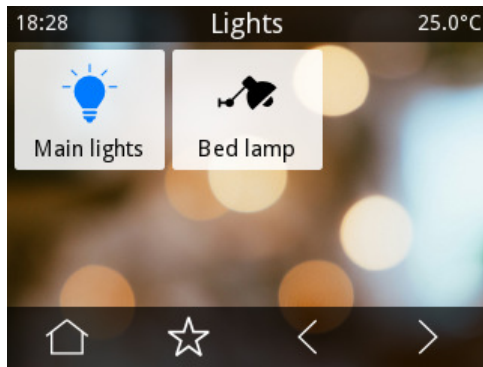

1




2



3



4

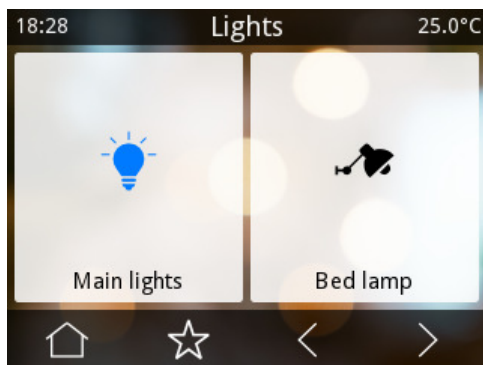

5


1. Fixed positions
2. Flexible – center
3. Flexible – center + stretch horizontally
4. Flexible – center + stretch vertically
5. Flexible – center + stretch in both directions

2.1.8 Access control

Most pages in the user interface can be password protected with a 4-digit PIN code in order to prevent unauthorized access.

Two access control schemes can be configured: Either one single password is used for all password-protected pages (one access level), or two different access levels are defined (“user” and “master”). In the latter case, the minimum access level required for each page must be configured. It must be noted that access levels are hierarchical: The “master” password also allows access to pages that require “user” access level. The opposite is not true: The “user” password does not allow access to pages that require “master” access level.

When the user tries to access a protected page, a password dialog will be shown. A valid PIN code must then be entered in order to gain access to the page.

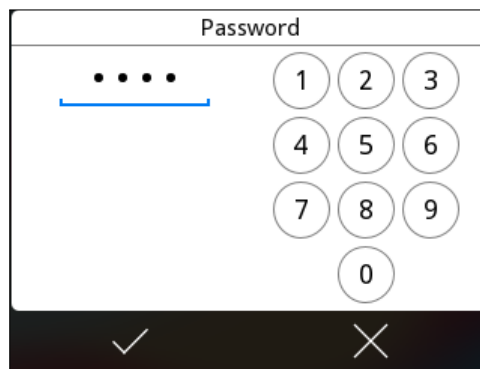

Current permissions remain in effect until the user returns to the Home page, either manually or automatically due to an inactivity timeout (see [2.1.9 Power saving mode](#)).

2.1.9 Power saving mode

After a certain period of inactivity (no user interaction), the device will automatically return to the Home page. Once on the Home page, and again after a certain period of inactivity, the device enters power saving mode.

During power saving mode, the display is automatically turned off and power consumption is minimized, even though all functions (such as time schedules, alarm monitoring, etc.) remain operational.

Both of these inactivity timeouts can be adjusted by the end user, or even disabled altogether, through the “Power saving” page (Preferences > Display > Power saving).

Note


Disabling the power saving timeout is **not recommended** for normal operation, since this may adversely impact the expected display lifetime.

Touching the screen automatically exits power saving mode. It is also possible to configure which page will be shown at this point: Either the Home page or the “default page” defined in the ETS configuration.

2.1.10 Touch gestures

VERSO Q supports the use of touch gestures for quickly executing up to five preconfigured actions. Touch gestures can be used while the device is in power saving mode, and also in the Home screen. The following gestures are detected:

- Swipe up
- Swipe down
- Swipe left
- Swipe right
- Multitouch gesture (touch the screen with more than one finger)

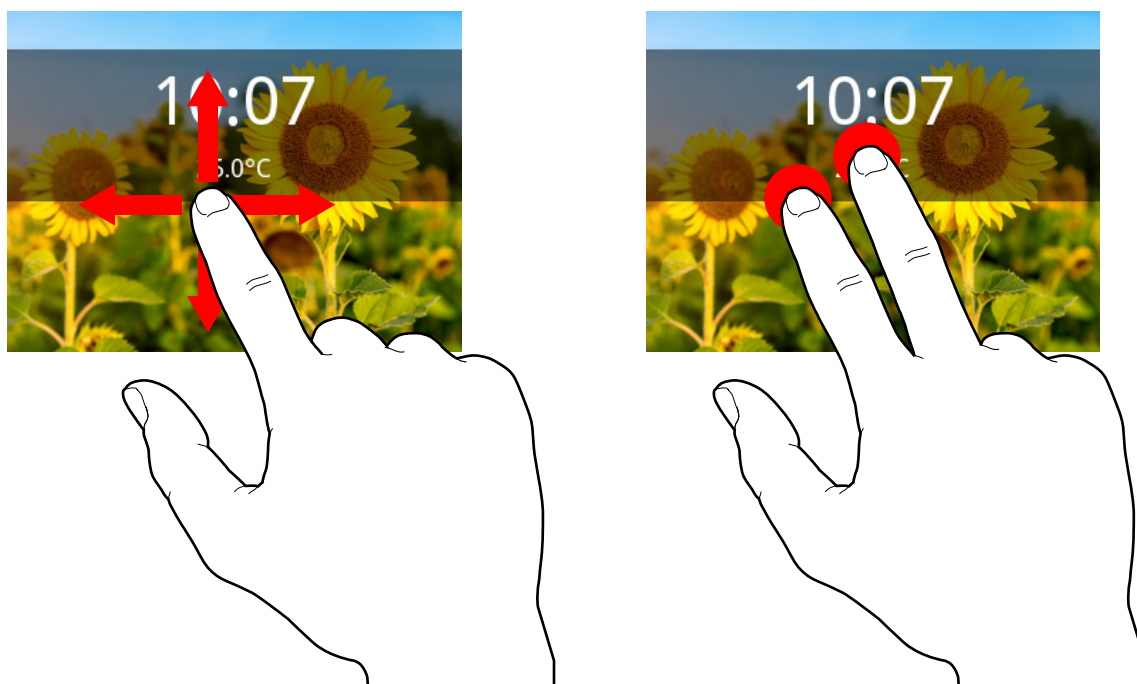

A different action can be configured for each gesture. When the touch gesture is detected, the associated action will be executed and the device will play a short confirmation sound.

Typical uses for touch gestures include switching on the lights in a dark room (the multitouch gesture makes this especially easy, as users just need to place their hand on top of the screen), or activating a “Welcome” or “Goodbye” scene when entering or leaving home.

2.2 Time schedules

2.2.1 Overview

For most components in the visualisation it is also possible to enable a “timer function”. When the timer function is enabled, the end user can setup actions to be run at scheduled times. For example, a dimmer control can be programmed to switch on a lamp at 75% intensity every day from Monday to Friday at 20:00, and to switch it off at 23:00.

Each component for which the timer function is enabled supports up to four separate timer programs, each of which in turn supports separate “start” and “end” actions.

The following parameters can be set by the user for each timer program:

- Start and end actions²
- Start and end action times
- Week days (SMTWTFS) when the program is valid (if weekly timers are enabled)

The week days parameter can be used to specify which days of the week the program should apply to.

2.2.2 Timer groups


Each component enabled as a timer can be optionally added to one of four available “timer groups”.

Timer groups can be locked (temporarily disabled) by sending a KNX telegram to a specific communication object. While a timer group is locked, any scheduled actions for components associated to that timer group will not run. This makes it possible to disable a group of timers temporarily, for example during short vacations.


² In some cases, actions are fixed and cannot be modified; for example, in a push button component that has been configured to run a scene, the action is fixed (run the associated scene)

2.2.3 Editing of timer programs

Components for which the timer function has been enabled will show up in the “Time schedules” page, which can be reached from the Menu page.

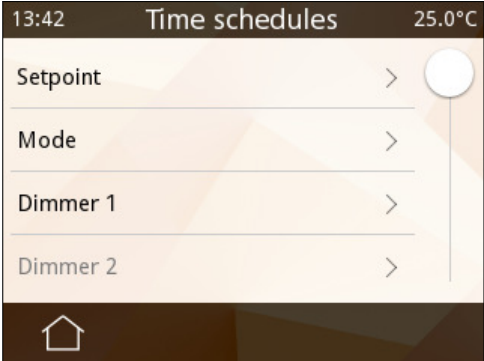


Selecting one component from the list shows the available programs:

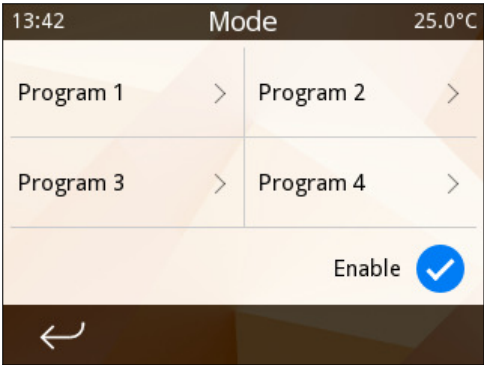

The “Enable” checkbox allows to manually enable or disable any configured actions. Note that this checkbox will be disabled if the component belongs to a timer group that is currently locked.

Selecting a program shows the program edit page, where all the parameters for the timer program can be edited.

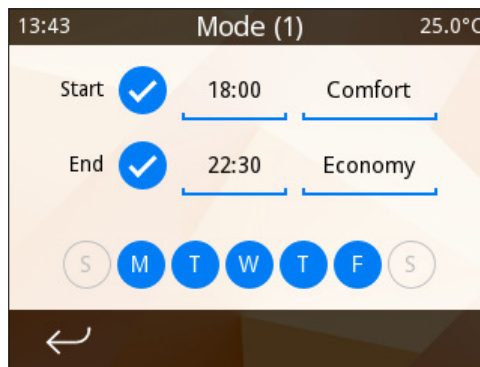

When a component has any scheduled actions enabled, a small clock icon ⌚ will be shown both in the component itself and in the corresponding page button in the Menu page.

2.2.4 Operation when the date and time are unknown

Time schedules require the current date and time to be available. Date and time are normally received from the KNX bus, but can also be set manually from the settings menu.

Until the time is known, no time schedules are run. If the time is known but the date is not, only programs that apply to every day of the week are run. Either case is indicated by a warning icon in the title bar:

Icon	Meaning
	Time unknown: no time schedules are run
	Date unknown: time schedules that are restricted to specific days of the week are not run

In addition, for components that have a scheduled action enabled which cannot be run for the reasons above, the component's clock icon is shown disabled:

2.3 Alarms

2.3.1 Overview

Components configured as “Indicator with alarm” combine two functions: On one hand they behave as regular Indicators, and as such they can display status values for an associated


communication object. In addition to that, they can also be used to detect alarm or fault conditions.

For this, the component provides two additional communication objects: A “trigger” object, and an “acknowledge” object.

When the “trigger” communication object receives an alarm value from the bus (the “alarm condition”), the alarm is activated. This is signalled both visually, in the user interface, and via the built-in buzzer device. The alarm will remain active until it has been acknowledged by the user and the trigger object has received the “no alarm” value.

Confirmation (acknowledgement) of the alarm can be done either manually, through the user interface, or by writing the acknowledge value to the “acknowledge” communication object.

The following flowchart shows the possible alarm states and the transitions between them:

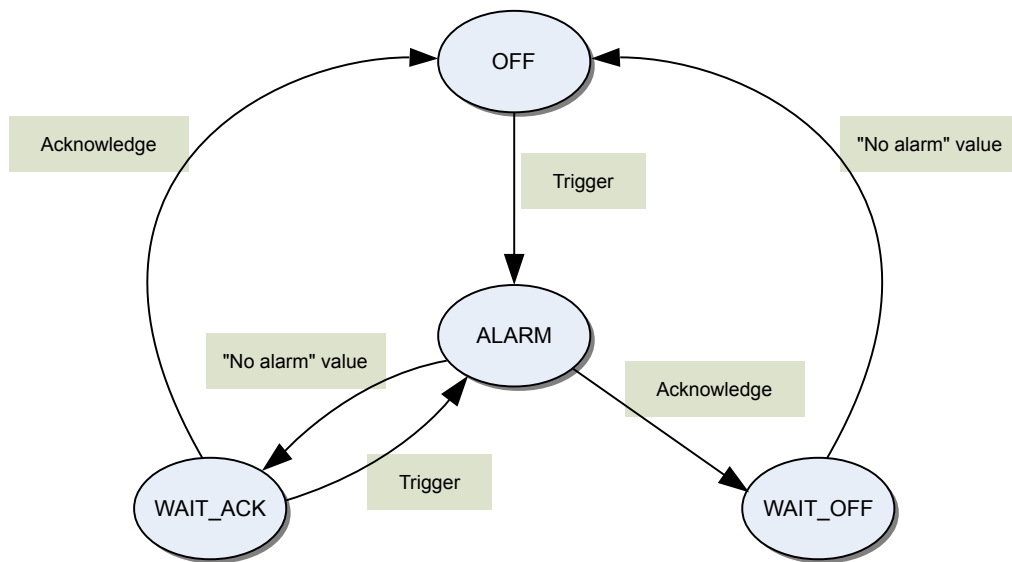

- Initially all alarms are in the OFF state
- When the alarm condition is triggered, the alarm switches to the ALARM state
- If an alarm is in the ALARM state and the alarm condition deactivates (the “no alarm” value is received), it switches to the WAIT_ACK state until it is acknowledged.
- If an alarm is in the ALARM state and the user acknowledges it, it switches to the WAIT_OFF state until the alarm condition deactivates.
- If an alarm is in the WAIT_ACK state and the alarm condition is triggered again, the alarm switches back to the ALARM state.

2.3.2 Alarm visualisation



All configured alarms, along with their current state, can be checked at any time from the “Alarms” page, which is reached from the Menu page.

Alarm state is shown as follows:

Symbols	State
● 	ALARM state
● 	WAIT_ACK state (waiting for acknowledgement)
● ✓	WAIT_OFF state (waiting for deactivation of the alarm condition)
●	OFF (idle) state

From this page it is also possible to acknowledge individual alarms (by selecting each one and touching the “Acknowledge” (✓) button), or all pending alarms at once with the “Acknowledge all” (✓✓) button.

The alarm status is also shown in the visualisation with a small status led on the component itself. Also, for any page with active alarms, a small status led will be shown in the corresponding page button in the Menu page.

2.4 Thermostats

2.4.1 Overview

VERSO Q implements two independent thermostats for ambient temperature regulation, and thus can be used to control two independent HVAC zones. Each thermostat can be configured for heating, cooling, or both heating and cooling. The thermostat continuously compares the

current room temperature with the current temperature setpoint, and controls operation of the heating and/or cooling actuators using a variety of control methods.

2.4.2 Room temperature

Current room temperature can be obtained from several sources:

- Temperature measured by the internal (built-in) temperature sensor³
- Temperature measured by an external temperature probe connected to one of the four available multifunction inputs
- Temperature provided by an external KNX device

For each thermostat, two different temperature sources can be selected and their temperature values averaged in order to calculate the actual room temperature. By combining the measurements from two different sources, it is possible to effectively filter local perturbations, e.g. from heat sources or air streams close to the sensors.

2.4.3 Setpoints

2.4.3.1 Operating Modes


The thermostat has four different operating modes: Comfort, Standby, Economy, and Building Protection.

- **Comfort mode:** The temperature setpoint is set to a value which enables normal use of the room at a pleasant temperature.
- **Standby mode:** The temperature setpoint is temporarily relaxed (i.e. the setpoint will be lowered if in Heating mode, or increased if in Cooling mode), for example during short absences. This helps reduce energy consumption, but at the same time allows for quickly returning to the comfort mode at any time.
- **Economy mode:** If the room will not be used for a longer period of time (for example during the night) the temperature setpoint can be relaxed even further in order to achieve higher energy savings.

³ Please check the note in section [2.1.6.3 System settings page](#) on page 15.

- **Building protection mode:** In this mode, the room thermostat is out of service. The room will only be heated (or cooled) if the room temperature has reached values so low (or high) that there is a risk of the installation being damaged from freezing or overheating.

Each of the four operating modes has its own temperature setpoint, as shown in the following diagram:

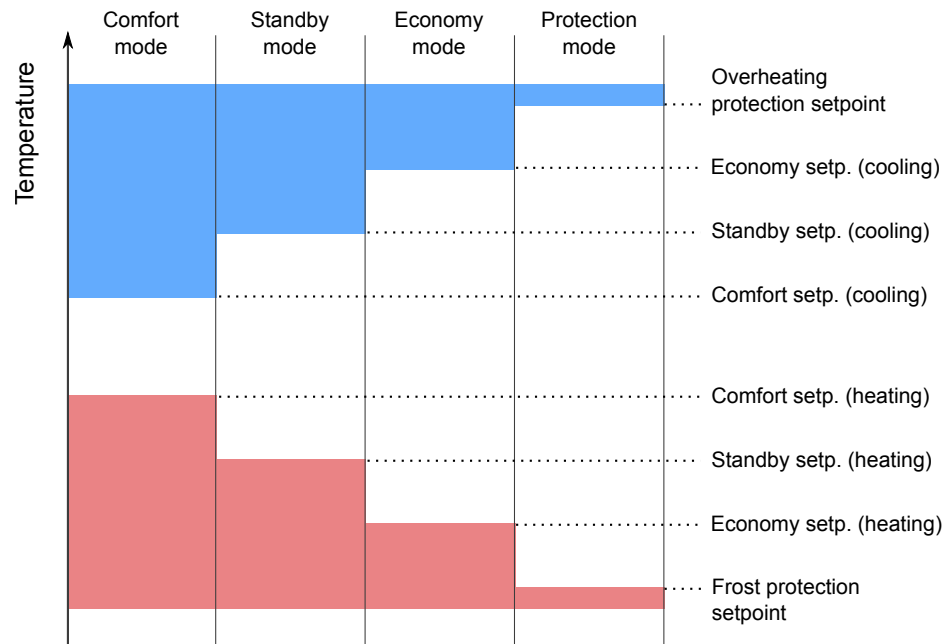

Setpoints can be defined in two ways: Absolute Setpoints and Relative Setpoints. Both methods are described next.

2.4.3.2 Absolute Setpoints

In the Absolute Setpoints method, setpoints for each operating mode are defined as absolute temperature values.

During operation, setpoints can be adjusted at any time by writing to the “Setpoint” communication object. Note that this may trigger an automatic change of operating mode, if the thermostat determines that there is an operating mode that better fits the requested temperature setpoint.

Example

Let's assume the following configuration:

- Thermostat is configured for cooling operation
- Comfort setpoint is set to 25°C
- Standby setpoint is set to 27°C

If the thermostat is initially in Comfort mode, and a value of 28°C is written to the “Setpoint” communication object, it will automatically switch to Standby mode.

A configuration parameter controls if and when temperature setpoint changes are stored permanently:

- **Never:** Temperature setpoint changes are never stored permanently.
- **Manually:** A “Save setpoint” communication object is enabled. By writing to this object, the current setpoint value will be stored as the default setpoint for the currently active operating mode, overwriting the initial value that was set in ETS.
- **Upon mode changes:** The current setpoint value will be automatically stored as the default setpoint for the currently active operating mode whenever there is an explicit change of operating mode, or when the thermostat switches from heating to cooling or vice-versa⁴.

Setpoints can be restored to their original values (as defined via ETS parameters) at any time via the “Reset setpoints” communication object.

The above discussion applies to the Comfort, Standby, and Economy operating modes. It is not possible to manually adjust the setpoint for Building protection mode.

2.4.3.3 Relative Setpoints

In the “Relative Setpoints” method, the effective setpoints for the Comfort, Standby, and Economy operating modes are defined relative to a common base value (the **base setpoint**), according to the following equation:

$$\text{Effective setpoint} = \text{Base setpoint} + \text{Mode offset} + \text{User offset}$$

The base setpoint can be modified at any time through the “Base setpoint” communication object. The **mode offset** for each mode is configured via ETS parameters, and cannot be changed at runtime. The **user offset** allows additional adjustment of the current setpoint within a configurable range.

⁴ Additional considerations apply if the thermostat is configured for automatic switching between heating and cooling. See [Additional considerations if Absolute Setpoints are used](#) on page 31.

The user offset can be modified through two communication objects: Either directly writing an offset value to the “Setpoint offset” object, or by writing a “1” or “0” value to the “Setpoint step” object. The latter will result in progressive adjustments of +/- 0.5°C in the current user offset.

A configuration parameter, “Reset user offset on operating mode changes” determines whether the current user offset should be reset to zero or carried over when the operating mode changes.

Finally, an additional “Reset offset” communication object allows to reset the user offset to zero at any time.

The above discussion applies to the Comfort, Standby, and Economy operating modes. The setpoint for the Building protection mode is always defined as an absolute setpoint, and cannot be changed at runtime.

2.4.3.4 Switching of operating modes

It is possible to toggle between operating modes at any time by writing to the associated communication objects. This can be done via a 1-byte object or via four 1-bit objects, one per mode. In turn, the 1-bit objects can be configured to work in “switch mode” or in “trigger mode”:

- **Trigger mode:** Writing a value “1” to one of the 1-bit objects will trigger the activation of the corresponding operating mode.
- **Switch mode:** Writing a value of “1” or “0” to any of the 1-bit objects will update the operating mode. The new operating mode will depend on the current value of all four 1-bit switch objects. The possible combinations are shown in the following table (“-” means that the object value is ignored).

Protection object	Comfort object	Economy object	Selected mode
1	-	-	Protection
0	1	-	Comfort
0	0	1	Economy
0	0	0	Standby

Note

Writing to the 1-byte mode object will always set the operating mode regardless of the value of the 1-bit objects, and vice-versa.

When a new operating mode is selected, the current temperature setpoint will be set to that of the new operating mode.

2.4.3.5 Forced protection mode

Under certain circumstances, it may be desirable to override the currently selected operating mode, and force the thermostat into Protection mode. This is called “Forced protection” mode.

This could be the case, for example, when windows are opened in a hotel room. For this purpose, an additional “Window status” communication object can be enabled, which could be connected to e.g. a window sensor. When the activation value (“1”) is written to this object, the thermostat automatically switches into Forced protection mode, and will remain in this mode as long as the communication object does not receive the deactivation value (“0”).

If the thermostat receives a request to change operating mode while it is in Forced protection mode, the request will be processed, but the change will not be effective until Forced protection mode is deactivated.

2.4.4 Heating and Cooling

Each thermostat can be configured to operate in heating mode only, in cooling mode only, or in combined heating and cooling mode.

If combined heating and cooling operation is selected, switching between heating and cooling can be done either manually (by means of an associated communication object) or automatically.

2.4.4.1 Automatic switching

If automatic switching of heating/cooling is selected, the thermostat will automatically determine the heating/cooling mode depending on the current room temperature and the configured temperature setpoints.

- If the thermostat is in **cooling mode**, it will automatically switch to Heating if the room temperature falls below the corresponding setpoint⁵ for Heating mode.

⁵ The setpoint that is considered is the one corresponding to the same operating mode that is currently active (comfort, standby, economy, protection) but for Heating mode.

- If the thermostat is in **heating mode**, it will automatically switch to Cooling if the room temperature rises above the corresponding setpoint for Cooling mode.

Example

If the thermostat is in heating / standby mode, it will automatically switch to cooling when the room temperature rises above the setpoint configured for cooling / standby mode.

Changeover protection band

In order to avoid situations where the thermostat is continuously switching between heating and cooling, an additional parameter is introduced that allows defining a “Changeover protection band”. The thermostat will not switch between heating and cooling until the difference between the room temperature and the current setpoint is *greater* than the protection band.

Example

Let's assume the following configuration:

- Thermostat is currently in Cooling mode
- Current operating mode is Comfort
- Comfort setpoint for cooling is set to 25°C
- Comfort setpoint for heating is set to 24°C
- Changeover protection band is set to 2°C
- Initial room temperature is 26°C

Normally, the thermostat would switch to heating mode as soon as the room temperature falls below 24°C. However, because the changeover protection band parameter is set to 2°C, the switch to heating mode will only happen when the room temperature falls below 23°C.

Additional considerations if Absolute Setpoints are used

In order to avoid malfunction of the thermostat, if the Absolute Setpoints method is used with automatic switching between heating and cooling, an additional limitation is introduced regarding permanent storage of setpoint changes. Namely, the device will always ensure that the comfort setpoint for cooling mode is never lower than the comfort setpoint for heating mode.

2.4.5 Control algorithms

The main function of the VERSO Q thermostats is to compare the current room temperature with the desired temperature (setpoint) and send appropriate commands to the KNX actuators (relay outputs, valve motors, etc.) that control the actual HVAC equipment.

To this end, VERSO Q thermostats support different control algorithms:

- Two-point control with hysteresis
- P-I control with continuous (analogue) output
- P-I control with PWM (switched) output

These algorithms are described next.

Note

If a thermostat is configured for both heating and cooling, a different control algorithm can be configured for each function. Thus, for example, a thermostat can be setup to use two-point control with hysteresis for cooling, and P-I control with PWM output for heating.


2.4.5.1 Two-point Control with Hysteresis

Two-point control with hysteresis is a simple and well-known control algorithm that is sometimes also referred to as “On/off control”. In this algorithm, the thermostat turns on the heating when the current room temperature is below the desired setpoint, and turns it off when the room temperature rises above the desired setpoint. The opposite holds true for cooling.

In order to prevent the output from quickly switching on and off when the room temperature is close to the setpoint value, different thresholds are considered for switching on and off. This behaviour is controlled with the *Hysteresis* configuration parameters (upper and lower hysteresis).


In Heating mode:

- The output is switched on when the room temperature is less than or equal to *Setpoint - lower hysteresis*
- The output is switched off when the room temperature is greater than or equal to *Setpoint + upper hysteresis*

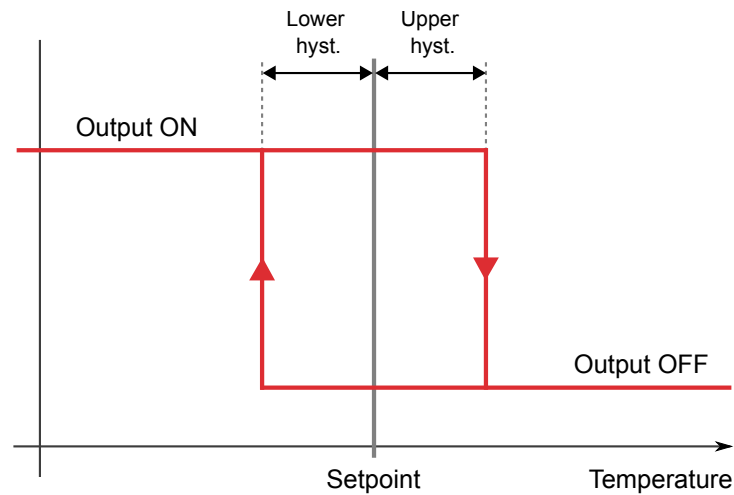


In Cooling mode:

- The output is switched on when the room temperature is greater than or equal to $\text{Setpoint} + \text{upper hysteresis}$
- The output is switched off when the room temperature is less than or equal to $\text{Setpoint} - \text{lower hysteresis}$

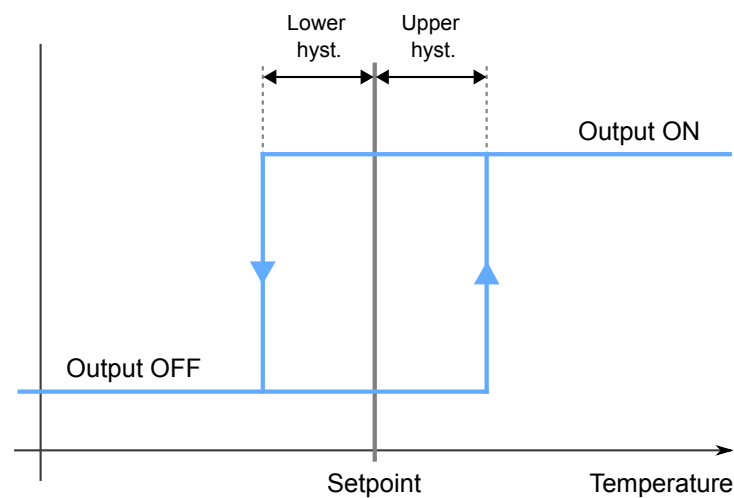

Two-point control with hysteresis is easy to setup and can be used with regular switching actuators. However, it is also sub-optimal in terms of power consumption and comfort, due to the typical fluctuations of the room temperature around the setpoint which arise as a result of the simple control algorithm.

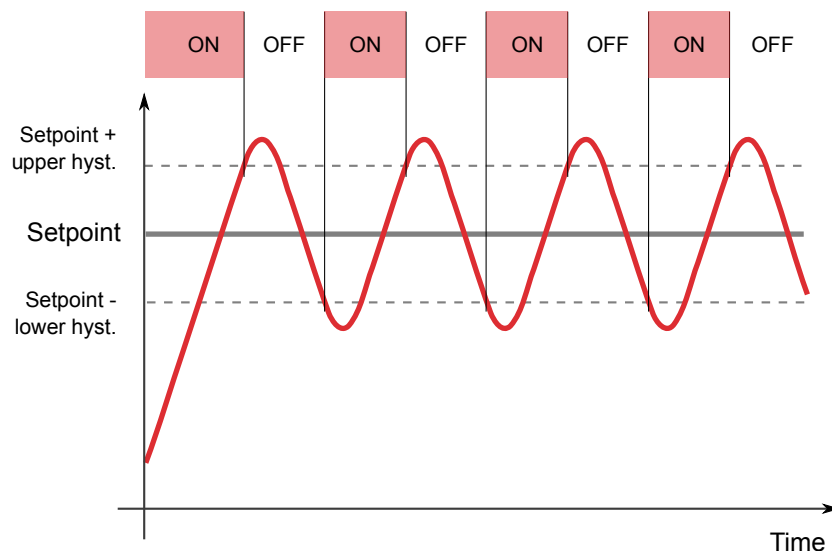

2.4.5.2 P-I Control with Continuous Output

Proportional-Integral (P-I) Control is a more complex control algorithm where the thermostat constantly measures the difference between the current room temperature and the desired setpoint (the *error term*), and computes an appropriate *correction value* based on the current difference, and also on the previous history of the system. This correction value (e.g. 0-100%) is periodically sent to a proportional HVAC actuator device.

When configuring a thermostat to use P-I Control, the following parameters must be considered:

- **Cycle time:** The control algorithm periodically compares the current room temperature with the desired setpoint, and computes the correction values to be applied. The cycle time determines how often this is done. Longer cycle times (typically 15-20 minutes) should be chosen for HVAC systems with high thermal inertia, such as radiant floor heating, and shorter cycle times (typically 10-15 minutes) for HVAC systems with low thermal inertia, such as air convection heating and cooling.
- **Proportional band:** The proportional band (measured in degrees) determines the magnitude of the output value relative to the error term. For example, a proportional band of 5°C means that the output will be set to 100% when the error (the difference between the current temperature and the desired setpoint) reaches 5°C. If the difference is only 1°C (20% of the proportional band), the output will be set to 20%, and so on.
- **Integral time:** The P-I control algorithm not only considers the current value of the error term at any given time, but also the “history” of the system; that is, the past values of

the error term. This makes it possible to react faster to changes in ambient conditions that impact the room temperature. Short integral times allow for fast reactions to such changes, but a too short integral time introduces a risk of permanent oscillations around the setpoint. Long integral times eliminate the risk of oscillations, but the reaction to external changes will be slower.

Note

Every time the desired temperature setpoint changes, the current cycle is interrupted, the new values are processed, and a new cycle is started. This allows the system to reach its steady state more quickly.

If the P-I control parameters are properly adjusted, the control algorithm may be able to efficiently control all common types of heating and cooling systems, thus making the room temperature control work as fast as possible and without deviation. However, tuning of the P-I control parameters is not straightforward, and even small changes to the parameters values can result in noticeable changes to the control performance: An incorrectly configured system may be too slow, needing a long time to reach the desired temperature setpoint, or it may fluctuate above or below the setpoint.

For this reason, a set of *predefined parameters* that correspond to the most common types of heating and cooling systems are available and can be easily selected, as shown in the following table. For expert users, the option of entering custom parameter values is also provided.

Application (heating)	Proportional band (K)	Integral time (min)	Recommended cycle time (min)
Warm water heating	5	150	15
Floor heating	5	240	15-20
Electric heating	4	100	10-15
Convection heating	4	90	10-15

Application (cooling)	Proportional band (K)	Integral time (min)	Recommended cycle time (min)
Cooling ceiling	4	240	15-20
Convection cooling	4	90	10-15


2.4.5.3 P-I Control with PWM Output

In the P-I Control algorithm described in the previous section (P-I Control with Continuous Output) the control variable that is periodically sent to the HVAC actuator is an analogue variable (0-100%). Thus, a proportional HVAC actuator is required.

In some cases, however, it is desirable to benefit from the advantages of P-I control, while still being able to use standard (lower cost) switching actuators, such as relays and actuators for zone valves. For this, the P-I Control algorithm with PWM Output can be used.

This is exactly the same as P-I Control with continuous output, except that proportional output values are implemented by switching a binary output on and off for certain time periods. The control algorithm operates periodically over a cycle (the cycle time); in each period, the output is switched on for a time that is proportional to the value of the control variable, and then switched off for the remainder of the period. For example, if the cycle time is 15 minutes, and the control variable should be set to 20%, the controller will keep the output on for 3 minutes (20% of the cycle time), and off for 12 minutes (80% of the cycle time).

By varying the ratio between the on and off times, also known as the *duty cycle*, the average time of activation of the output, and in turn the average supply of heating or cooling power, can be effectively controlled.

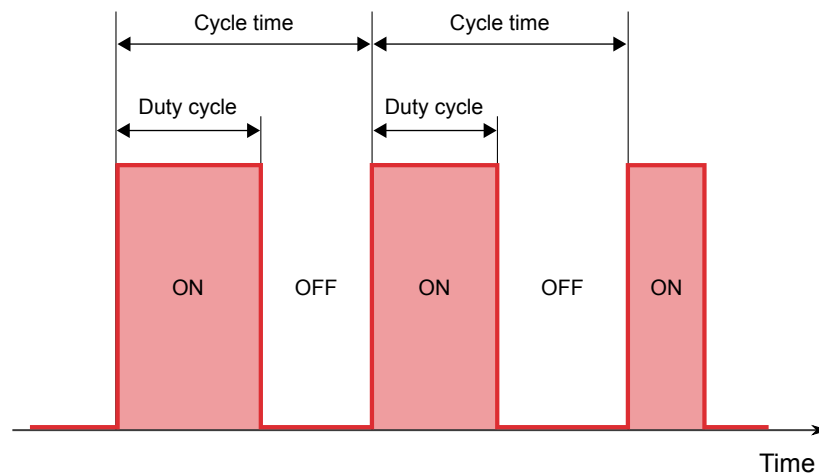

Note

In order to avoid damage to the switching actuator, if the computed on or off time is shorter than 5 seconds, a fixed time of 5 seconds is used instead.

2.4.6 Additional heating and cooling

Some HVAC systems, such as radiant floor heating systems, exhibit a very high thermal inertia, which translates to slow response times at start-up, or when there are changes in the working conditions (ambient temperature or desired setpoint).

In order to improve response times for such systems, auxiliary heating or cooling systems with lower thermal inertia are often installed. These auxiliary systems, often called “second stage” systems, are temporarily switched on when there is a large difference between the room temperature and the setpoint, thus contributing to a faster heating or cooling of the room, and are switched off when this difference becomes smaller and can be handled by the main system.

The VERSO Q thermostats can be configured to control these auxiliary heating or cooling systems, if they are installed. For this, it is necessary to define a temperature range where the auxiliary system will kick in. This is configured through the “Additional heating (or cooling) band” parameter:

In Heating mode:

- Additional heating is switched on when the room temperature is less than or equal to *Setpoint - additional heating band*
- Additional heating is switched off when the room temperature is greater than or equal to *Setpoint - additional heating band + 0.5 °C*

In Cooling mode:

- Additional cooling is switched on when the room temperature is greater than or equal to *Setpoint + additional cooling band*
- Additional cooling is switched off when the room temperature is less than or equal to *Setpoint + additional cooling band - 0.5 °C*

2.5 Multifunction inputs

VERSO Q features four multifunction inputs, each of which can be individually configured in one of the following ways:

- Binary - Push button
- Binary - Switch/sensor
- Temperature probe

For a detailed description of the available configuration options for each type of input, see [3.6 Inputs](#) on page 83.

2.5.1 Binary inputs

2.5.1.1 Push button inputs

Push button inputs are typically connected to external push buttons, and can be configured to trigger different actions upon detection of “short” and “long” presses. For example, a push button input can be connected to a physical push button to control a light dimmer. Short presses can be configured to toggle the light on and off, while a long press can be configured to start a dimming operation.

For each input configured as a push button input, a configuration parameter allows to customize the minimum press time to differentiate between short and long press operations.

2.5.1.2 Switch/sensor inputs

Switch/sensor inputs are typically connected to external switches or sensors, and can be configured to trigger different actions when the input contact closes and when the contact opens.

A typical use case for switch/sensor inputs is to connect external alarm sensors; for example, a fire detector, or a magnetic door/window sensor. Different actions can be triggered when the alarm condition is detected, and also when the alarm condition deactivates.

2.5.1.3 Input locking

For each binary input, an optional “Input lock” communication object is available. This object allows to temporarily disable operation of the associated input. While an input is locked, short and long presses (for push button inputs) or state transitions (for switch/sensor inputs) are ignored, and the corresponding actions are not triggered.

2.5.2 Temperature probe inputs

Temperature probe inputs can be used to measure temperature from connected temperature probes.

A configurable offset can be added to the measured value in order to compensate for the effect of local heat sources or air drafts that might be close to the probe location.

Temperature values are made available through an associated communication object. Values can be sent to the bus periodically, and/or when a certain change between the current value and the last value sent to the bus is detected. If the temperature cannot be read (for example, if the probe is broken, or if it is physically disconnected from the input) an error condition is signalled through a separate error object.

An **alarm function** can be enabled for each temperature probe input. The alarm function can be configured to detect high temperatures, low temperatures, or both high and low temperatures. When the temperature value exceeds the configured limits, an alarm condition is signalled through a specific “alarm” communication object.

Configuration

3.1 General considerations

This chapter describes the configuration parameters available in the ETS product database for VERSO Q.

Configuration parameters are organized in groups, or *configuration sections*; this chapter follows the same structure. For each section, the corresponding configuration parameters are shown in table format. For each parameter, available options are listed. The default value is indicated in **bold**.

Some parameters allow entering text values. These are labeled as [Text field] in parameter tables. Regular text fields have a maximum length of 20 bytes. Text fields used for units in numerical values have a maximum length of 6 bytes. In some cases, the maximum length might be different.

Note

All texts are stored using Unicode UTF-8 encoding. Encoding of ASCII characters requires 1 byte per character; however, encoding of characters outside the ASCII range requires more than 1 byte per character. Thus the maximum number of characters allowed will depend on the actual characters used in the text. It is recommended to check that the full texts are actually visible on the screen after programming.

Some parameters allow selecting an icon. These are labeled as [Icon selection]. For a complete list of available icons, please refer to the VERSO Q icon list, available for download from www.iddero.com.

In most cases, when an icon is used, the icon colour can also be configured. These parameters are labeled as [Icon colour] in parameter tables.

3.2 Main

3.2.1 General

Parameter name	Values
Project name	[Text field]
Enable weekly timers	[Checkbox]
Send read requests at startup	No / Yes
Startup requests initial delay (If “Send read requests at startup” is enabled)	0 ... 255 (x 1 s)
Thermostat 1	[Checkbox]
Thermostat 2	[Checkbox]
Inputs	[Checkbox]

The *Project name* field can be used to enter a descriptive project name. This will be shown in the System Settings > Info page.

The *Enable weekly timers* parameter determines whether timer programs can be restricted to specific days of the week (see [2.2 Time schedules](#) on page 21). This requires knowing the current date, which is received from the bus. If the installation provides the time but not the date, this parameter should be disabled; in that case the week days selection is not shown in the user interface.

If *Send read requests at startup* is enabled, the device will send read requests to the bus for all the status objects related to the visualisation. This makes it possible to update the displayed states when the device is initially switched on, or after power cycling. The *Startup requests initial delay* parameter controls the initial delay before the device starts to send these read requests.

The *Thermostat 1*, *Thermostat 2*, and *Inputs* parameters enable the corresponding configuration sections. See [3.5 Thermostats](#) on page 75 and [3.6 Inputs](#) on page 83.

Date and time communication objects

The *Date* (DPT 11.001) and *Time* (DPT 10.001) communication objects are always enabled. Since VERSO Q does not have a battery-backed real-time clock (RTC), it is important that it receives the date and time periodically from the KNX bus.

Note

It is recommended to configure the device that sends the date and time to the bus to use a short sending period (for example, every minute). This ensures that VERSO Q obtains the correct date and time as soon as possible after startup, and that any clock adjustments take effect promptly.

If the date and time are modified through the user interface (Preferences > Date & time), the new values are sent to the bus through these objects.

3.2.2 Internal temperature sensor

Parameter name	Values
Calibration offset	-50 ... 0 ... 50 (x 0.1°C)
Sending period	0 ... 255 (x 10 s, 0 = Disabled)
Send when change is greater than	0 ... 255 (x 0.1°C, 0 = Disabled)

This section allows configuration of the internal temperature probe.

The *Calibration offset* parameter defines the initial value of the calibration offset to be added to the measured temperature values. This offset can also be adjusted from the user interface (System settings > Temperature Probe)

The corrected temperature values are made available through the *Internal temperature* communication object (DPT 9.001). The *Sending period* and *Send when change is greater than* parameters can be used to control when this object is updated (and its value sent to the bus)

3.2.3 Timer groups

Parameter name	Values
Timer group 1 lock object	[Checkbox]
Timer group 2 lock object	[Checkbox]
Timer group 3 lock object	[Checkbox]
Timer group 4 lock object	[Checkbox]

As described in [2.2 Time schedules](#) on page 21, timers can optionally be added to one of four available timer groups. This allows to temporarily lock (disable) groups of timers with a single operation.

The parameters in this section control whether the corresponding lock objects (*Timer group 1 lock ... Timer group 4 lock*) are available.

3.3 User Interface

3.3.1 General

Parameter name	Values
Page 1	[Checkbox]
...	
Page 6	[Checkbox]
Favorites	[Checkbox]
Default language	English / Deutsch / Español / Français
Default theme	Light / Dark
Show time in title bar	No / Yes
Show temperature in title bar	No / Yes
Show time in home page	No / Yes
Show date in home page (Only if time is also displayed)	No / Yes
Show temperature in home page	No / Yes
Source for temperature display (Only if temperature is displayed in title bar and/or home page)	Internal sensor Temperature Probe IN1 Temperature Probe IN2 Temperature Probe IN3 Temperature Probe IN4 External object
Default page after home page	Menu / Page 1 ... Page 6 / Favorites
Regulation and rotary controls behaviour	Send when dialog is confirmed Send on touch release

Checkboxes *Page 1 ... Page 6* and *Favorites* enable the corresponding pages.

Parameter *Default language* selects the default language for system texts. This setting can be modified from the user interface at any time (Preferences > Language).

Parameter *Default theme* selects the default appearance of the user interface (light or dark mode). This setting can be modified from the user interface at any time (Preferences > Display > Theme).

Parameters *Show time in title bar* and *Show temperature in title bar* control what information will be shown in the title bar, besides the name of the current page.

Parameters *Show time in home page*, *Show date in home page*, and *Show temperature in home page* control what information will be shown in the Home page. The date can only be displayed together with the time.

If the temperature is set to be displayed in the title bar and/or in the Home page, an additional parameter *Source for temperature display* allows selecting the source for the displayed temperature: The internal temperature probe, an external probe connected to one of the multifunction inputs, or an external communication object. If the latter is selected, communication object *External temperature* (DPT 9.001) will be enabled.

Note

When using an external probe connected to one of the multifunction inputs as a temperature source, make sure to configure the input accordingly.

Parameter *Default page after home page* controls which page will be the first one shown immediately after the Home page. This can be the Menu page, any of the configured control pages, or the Favorites page.

Parameter *Regulation and rotary controls behaviour* determines the user interface behaviour for regulation bars and rotary controls. The default is to send the final value to the bus just once, when the dialog is confirmed (closed). However, it is also possible to send updated values to the bus while adjusting, every time the touch is released.

3.3.2 Power saving mode

Parameter name	Values
Timeout for home page	0 ... 5 ... 60 (x 1 min, 0 = Disabled)
Timeout for power saving mode	0 ... 5 ... 60 (x 1 min, 0 = Disabled)
Page to show when leaving power saving mode	Home page / Default page
Enable wake up object	[Checkbox]

This section controls the behaviour of the power saving mode (see [2.1.9 Power saving mode](#) on page 19). The *Timeout for home page* and *Timeout for power saving mode* parameters define the initial timeout values. Both of them can be adjusted from the user interface (Preferences > Display > Power saving).

Parameter *Page to show when leaving power saving mode* determines which page will be shown when leaving power saving mode. This can be either the Home page or the “default” page defined in the previous section.

A special *Wake up* communication object can optionally be enabled with the *Enable wake up object* parameter. Writing the value “1” to this object wakes the device from power saving mode.

3.3.3 Access control

Parameter name	Values
Restricted access levels	One level / Two levels
<i>Additional parameters for “One level”:</i>	
Default password:	
- Digit 1	0 ... 1 ... 9
- Digit 2	0 ... 1 ... 9
- Digit 3	0 ... 1 ... 9
- Digit 4	0 ... 1 ... 9
<i>Additional parameters for “Two levels”:</i>	
Default User password:	
- Digit 1	0 ... 1 ... 9
- Digit 2	0 ... 1 ... 9
- Digit 3	0 ... 1 ... 9
- Digit 4	0 ... 1 ... 9
Default Master password:	
- Digit 1	0 ... 2 ... 9
- Digit 2	0 ... 2 ... 9
- Digit 3	0 ... 2 ... 9
- Digit 4	0 ... 2 ... 9

Pages in the user interface can be password protected with 4-digit PIN codes (see [2.1.8 Access control](#) on page 19). The parameter *Restricted access levels* defines whether one single password is used for all protected pages (“One level”), or whether separate user and master passwords are used (“Two levels”).

The setting of this parameter also determines the available options for configuration parameters that relate to access control for individual pages. These are labeled as [Access control options] in parameter tables. The available options in each case are:

- If “One level” is selected: **No** / Yes
- If “Two levels” is selected: **No** / User password / Master password

Default (initial) passwords are also defined in this section. Passwords can be modified at any time through the user interface (Preferences > Passwords).

3.3.4 Main menu

Parameter name	Values
Menu page layout	Fixed positions Flexible – center Flexible – center + stretch horizontally Flexible – center + stretch vertically Flexible – center + stretch in both directions
Restrict access to Menu page	[Access control options]
Restrict access to Alarms page	[Access control options]
Restrict access to Timers page	[Access control options]

This section allows configuration of the Menu page layout, and access control for the Menu page, as well as for the Alarms and Time schedules pages.

The selected layout applies to the main menu page only, which is where the control pages are shown. If a second menu page is used to show the time schedules and/or alarms pages, this second page always uses a centred layout.

3.3.5 Settings pages

Parameter name	Values
Restrict access to Settings page	[Access control options]
Restrict access to User Preferences page	[Access control options]
Restrict access to System settings page	[Access control options]

This section allows configuration of access control for settings pages.

3.3.6 Favorites

Parameter name	Values
Favorites page layout	Fixed positions Flexible – center Flexible – center + stretch horizontally Flexible – center + stretch vertically Flexible – center + stretch in both directions
Restrict access to Favorites page	[Access control options]
Restrict access to Edit Favorites page	[Access control options]

This section allows configuration of the Favorites page layout, and access control for the Favorites and Edit Favorites page.

3.3.7 Touch gestures

Parameter name	Values
Gesture: Up	Disabled / Send binary value / Run scene
Value to send (Only for “Send binary value”)	0 / 1
Scene number (Only for “Run scene”)	1 ... 64
Gesture: Down	<i>Same parameters as for Gesture: Up</i>
Gesture: Left	<i>Same parameters as for Gesture: Up</i>
Gesture: Right	<i>Same parameters as for Gesture: Up</i>
Gesture: Multitouch	<i>Same parameters as for Gesture: Up</i>

Configuration of touch gestures is carried out in this section (see [2.1.10 Touch gestures](#) on page 20). A different action can be configured for each of the five supported touch gestures. This can be either sending a binary value to the bus (“0” or “1”), or triggering a scene.

If a binary action is configured, a communication object (*Gesture: Up*, *Gesture: Down*, *Gesture: Left*, *Gesture: Right*, or *Gesture: Multitouch*) will be enabled. The selected value (*Value to send*) will be written to this communication object.

If a scene action is configured, a scene recall request will be sent through the *Run/save external scene* object when the gesture is detected.

3.4 Control Pages

3.4.1 General

Parameter name	Values
Name	[Text field]
Icon	[Icon selection]
Page type	Regular page / Thermostat page

Each page has a *Name* and optionally an *Icon*. The name and icon are shown in the Menu page. Additionally, the name is shown in the title bar when the page is displayed.

The *Page type* parameter determines whether the page is a regular control page or a thermostat page. The remaining parameters depend on the selected page type.

3.4.1.1 Regular page

Parameter name	Values
Page layout	Fixed positions Flexible – center Flexible – center + stretch horizontally Flexible – center + stretch vertically Flexible – center + stretch in both directions
Restrict page access	[Access control options]
Component 1	[Checkbox]
...	
Component 6	[Checkbox]

A regular control page shows up to six components, arranged according to the selected *Page layout*. The page access restrictions can also be configured (*Restrict page access*).

The *Component 1* ... *Component 6* checkboxes can be used to enable or disable each component. For their configuration, see [3.4.2 Components](#) on page 52.

3.4.1.2 Thermostat page

Parameter name	Values
Restrict page access	[Access control options]
Additional component 1	[Checkbox]
Additional component 2	[Checkbox]
Additional components position (Only if at least one additional component is enabled)	Left / Right

A thermostat page always shows a setpoint control, which is described next.

The *Additional component 1* and *Additional component 2* checkboxes can be used to enable up to two additional components, which are shown next to the setpoint control. These are configured in the same way as the components of a regular control page (see [3.4.2 Components](#) on page 52).


The *Additional components position* parameter determines whether the additional components are shown to the left or to the right of the setpoint control.

The page access restrictions can also be configured (*Restrict page access*).

Setpoint control

Parameter name	Values
Name	[Text field]
Minimum value	-30 ... 15 ... 100 (°C)
Maximum value	-30 ... 40 ... 100 (°C)
Initial value	-30 ... 22 ... 100 (°C)
Show room temperature	[Checkbox]
On/Off function	Always ON Local control and external objects Control via external object only
Dial colour	Red Blue Depending on heating/cooling mode

The setpoint control shows a dial that allows selecting a temperature setpoint, which is sent to the bus through the *Setpoint control* object (DPT 9.001). The displayed setpoint is also updated according to the value of the *Setpoint indicator* object.

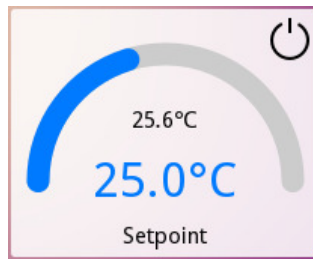

The *Minimum value* and *Maximum value* parameters determine the range of setpoint values that can be selected. The *Initial value* parameter determines the initial value of the dial.

If *Show room temperature* is enabled, an additional communication object (*Room temperature indicator*) is provided, and the received value is shown alongside the setpoint.

The *On/Off function* parameter determines whether the setpoint control can be switched on and off; while the control is off, it cannot be operated. The available options are:

- *Always ON*: The control is always on.
- *Local control and external objects*: The user can switch the control on and off from the visualisation; the on/off commands are sent to the bus through the *On/Off control* object. Additionally, the *External On/Off* object is provided for external On/Off control through the bus.
- *Control via external object only*: The on/off state is controlled exclusively through the bus.

Note

Note that when the *On/Off function* is set to “Control via external object only”, if a switch-off command is received through the bus, the user will not be able to interact with the control until a switch-on command is received. To avoid this, consider selecting “Local control and external objects” instead.

The *Dial colour* parameter determines the colour of the setpoint dial: it can be fixed (*Red* or *Blue*), or it can be configured to change according to an external object (*Depending on heating/cooling mode*). In the latter case, an additional 1-bit communication object (*Heating/Cooling mode indicator*) is provided to receive the current mode.

The setpoint control supports a timer function; please see [3.4.3 Timer function](#) on page 73.

3.4.2 Components

Parameter name	Values
Name	[Text field]
Component type	Indicator Indicator with Alarm Push Button Double Push Button Regulation Bar Rotary Control Numeric Keypad Dimmer Control Shutter Control RGBW Control

All components have a *Name*, which is displayed in the visualisation.



A *Component type* must also be selected. Available configuration options are specific to each component type, and are described separately in the following sections.

Note that there is no need for a dedicated “Timer” component type, as most component types support a timer function (see [3.4.3 Timer function](#) on page 73).

3.4.2.1 Indicator

Parameter name	Values
Indicator type	Binary Enumerated Numerical Level bar Level dial

Indicators can be used for the visualisation of status values. They display the current value of an associated communication object.



Several indicator types are supported. Each type is described separately.

Binary

Parameter name	Values
Text for 0/Off	[Text field]
Icon for 0/Off	[Icon selection]
- Icon colour	[Icon colour]
Text for 1/On	[Text field]
Icon for 1/On	[Icon selection]
- Icon colour	[Icon colour]

Binary indicators display the state of an associated binary (DPT 1) object, *Binary indicator*.

Both an icon and/or a text label can be associated to each of the two possible states of the communication object (“1”/On and “0”/Off).

Enumerated

Parameter name	Values
Number of states	1 ... 6
Value for state 1	0 ... 255
Text for state 1	[Text field]
Icon for state 1	[Icon selection]
- Icon colour	[Icon colour]
States 2 ... 6	<i>Same parameters as for state 1</i>
Define fallback state	[Checkbox]
Text for fallback state (If fallback state is enabled)	[Text field]
Icon for fallback state (If fallback state is enabled)	[Icon selection]
- Icon colour	[Icon colour]

Enumerated indicators can display several different states, depending on the value of an associated 1-byte (DPT 5.010) communication object. Values can range from 0 to 255.

Up to 6 states can be defined. Each of these states is associated with a specific value of the communication object. For each state, it is possible to define both an icon and/or a text label.

The icon and/or text will be shown when the corresponding value is received through the communication object.

Additionally, it is possible to define the icon and/or text label for a so called “fallback state”. The fallback state icon and/or text will be shown when a value that is not associated to any other state is received through the communication object.

If no fallback state is defined, received values that do not match any state will be ignored.

Numerical

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float 4-byte unsigned int 4-byte signed int 4-byte float
Decimal places (Only for float data types)	Automatic / 0 / 1 / 2
Units (Except for “Percentage” data type)	[Text field]

Numerical indicators display the value of the associated communication object as a number. The following table shows the available data types for the communication object and the corresponding value ranges:

Data type	Value range
1-byte unsigned int	0 ... 255
1-byte signed int	-128 ... 127
Percentage	0% ... 100%
2-byte unsigned int	0 ... 65535
2-byte signed int	-32768 ... 32767
2-byte float	-671088.64 ... 670760.96
4-byte unsigned int	0 ... 4294967295
4-byte signed int	-2147483648 ... 2147483647
4-byte float	-3.4028E+38 ... 3.4028E+38

For the 2-byte and 4-byte float data types, it is possible to define the number of decimal places to show (*Decimal places* parameter). This can be set to 0, 1, 2, or Automatic; with the “Automatic” option, the number of decimal places to show is determined automatically by the device, depending on the actual object value:

- Two decimal places if the absolute value is less than 1
- One decimal place if the absolute value is 1 or greater, and less than 100
- No decimal places if the absolute value is 100 or greater

Additionally, for the 4-byte float data type, large values (absolute value greater than 1000000) are always represented using scientific notation.

Finally, for all data types except “Percentage”, a text suffix (*Units* parameter) can be added to represent value units, such as “°C”. This suffix will be displayed immediately after the numeric object value.

Level bar

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float
Decimal places (Only for “2-byte float” data type)	Automatic / 0 / 1 / 2
Units (Except for “Percentage” data type)	[Text field]
Minimum bar value	[See description]
Maximum bar value	[See description]

Level bar indicators are similar to numerical indicators, and support the same data types (except for 4-byte data types), but the value of the associated communication object is represented as a level bar. In addition, the value is also displayed in textual form above the level bar.

The *Minimum bar value* and *Maximum bar value* parameters allow to limit the effective range of values that are used to determine the bar level. Values that are out of this range will be represented as an empty or full bar, respectively. The textual representation of the value is not affected by these parameters.

Example

A level bar with the data type set to 2-byte float can be used to represent temperature values. The “minimum bar value” and “maximum bar value” parameters can be used to define the range of temperatures to be represented in the level bar; for example, 0 to 60°C. If a value of 80°C is received, the level bar would be represented as full (as for any value above 60°C), however the actual numeric value (80°C) would still be displayed above the bar.

The range of valid values for the *Minimum bar value* and *Maximum bar value* parameters equals the range of the selected data type. The default value for the parameter will be the minimum or maximum value of the valid range, respectively.

Level dial

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float
Decimal places (Only for “2-byte float” data type)	Automatic / 0 / 1 / 2
Units (Except for “Percentage” data type)	[Text field]
Minimum dial value	[See description]
Maximum dial value	[See description]

Level dial indicators are completely equivalent to level bar indicators. The only difference is that for the graphical representation of the value, a circular dial is used instead of a level bar.

3.4.2.2 Indicator with Alarm

Parameter name	Values
Alarm trigger value	0 / 1
Alarm acknowledge value	0 / 1

Indicators with Alarm function are regular indicator components that in addition can be used to detect alarm or fault conditions.

For this, two additional communication objects are enabled: *Alarm trigger* and *Alarm acknowledge*. The activation value for both objects is selected via the parameters *Alarm trigger value* and *Alarm acknowledge value*, respectively.




See [2.3 Alarms](#) on page 23 for a detailed description of the alarm function.

3.4.2.3 Push Button

Parameter name	Values
Push Button type	Binary Choice Numerical Scene

Push button components allow sending predefined values to the bus through an associated communication object (the “control” object).

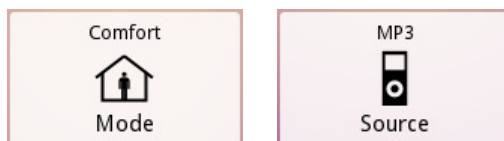

In some cases, depending on the component configuration, an additional communication object is enabled (the “indicator” or status object). When new values are received from the bus through this object, the component status is automatically updated.

Several push button types are supported. Each type is described separately.

Binary

Parameter name	Values
Action	Send 0 Send 1 Toggle Short 0, long 1 Short 1, long 0 Press 0, release 1 Press 1, release 0
<i>Parameters for “Send 0” and “Send 1”:</i>	
Button text	[Text field]
Button icon	[Icon selection]
- Icon colour	[Icon colour]
<i>Parameters for all other actions:</i>	
Button text for 0/Off	[Text field]
Button icon for 0/Off	[Icon selection]
- Icon colour	[Icon colour]
Button text for 1/On	[Text field]
Button icon for 1/On	[Icon selection]
- Icon colour	[Icon colour]

When binary push buttons are pressed, a value is sent to the bus through the associated binary (DPT 1) communication object, *Binary control*.

The specific behaviour of the button depends on the *Action* parameter. The following choices are available:

- *Send 0*: Sends the value “0” (off) when the button is pressed.
- *Send 1*: Sends the value “1” (on) when the button is pressed.
- *Toggle*: Alternates sending “0” (off) and “1” (on) on each button press (the first time, the value “1” (on) is sent).
- *Short 0, Long 1*: Sends “0” on a short press, “1” on a long press.
- *Short 1, Long 0*: Sends “1” on a short press, “0” on a long press.
- *Press 0, Release 1*: Sends “0” when the user starts pressing the button, and “1” when the button is released.

- *Press 1, Release 0*: Sends “1” when the user starts pressing the button, and “0” when the button is released.

For actions that send a single fixed value (*Send 0* and *Send 1*), it is possible to define both an icon and/or text label that will be shown in the push button component.


For actions that can send two different values (all other actions), it is possible to define separate icons and/or text labels for the values “0” and “1”. The component will show the icon and/or text corresponding to the last value that was sent.

Choice

Parameter name	Values
Number of options	1 ... 6
Option 1 value	0 ... 255
Option 1 text	[Text field]
Option 1 icon	[Icon selection]
- Icon colour	[Icon colour]
Options 2 ... 6	<i>Same parameters as for option 1</i>
Show fixed icon/text	No / Yes
Button text (If fixed icon/text is selected)	[Text field]
Button icon (If fixed icon/text is selected)	[Icon selection]
- Icon colour	[Icon colour]

Choice Push Buttons can be used to send one of several predefined values to the bus through the associated 1-byte (DPT 5.010) communication object. Values can range from 0 to 255.

Up to 6 options can be defined. Each of these options is associated with a value to be sent to the bus. For each option, it is possible to define both an icon and/or a text label. When the button is pressed, a pop-up dialog will be shown allowing the user to select one of the available options. The value associated with the selected option will then be sent to the bus.

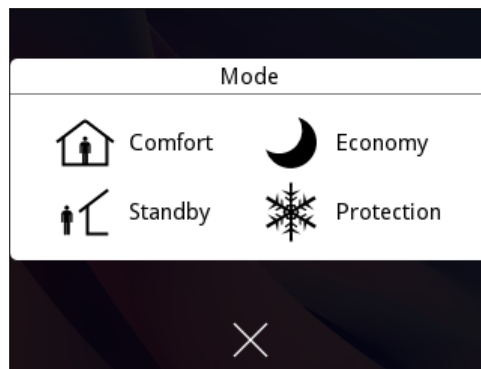

By default, the push button will show the icon and/or text corresponding to the last option that was selected. However, if the *Show fixed icon/text* parameter is set to “Yes”, a fixed icon and/or text will be displayed on the component instead.

Numerical

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float
Action	Send fixed value Send A/B values on short/long press
<i>Parameters for “Send fixed value”:</i>	
Value	[See description]
Button text	[Text field]
Button icon	[Icon selection]
- Icon colour	[Icon colour]
<i>Parameters for “Send A/B values...”:</i>	
Value A	[See description]
Text for value A	[Text field]
Icon for value A	[Icon selection]
- Icon colour	[Icon colour]
Value B	[See description]
Text for value B	[Text field]
Icon for value B	[Icon selection]
- Icon colour	[Icon colour]

Numerical push buttons are similar to binary push buttons, but allow sending either a fixed numeric value, or one of two possible numeric values to the associated communication object.

The specific behaviour of the button depends on the *Action* parameter. The following choices are available:

- *Send fixed value*: Sends a fixed value when the button is pressed.
- *Send values A/B on short/long press*: Sends a configured value (A) on short press, and another value (B) on long press.

The range of valid values for the *Value*, *Value A*, and *Value B* parameters equals the range of the selected data type. The default value for all three parameters is 0.

Scene

Parameter name	Values
Scene number	1 ... 64
Allow saving scene	No / Yes
Button text	[Text field]
Button icon	[Icon selection]
- Icon colour	[Icon colour]

Scene push buttons allow activating or saving a scene. The *Scene number* parameter allows specifying the target scene (1-64).

The scene recall or store request will be sent through the global *Run/save external scene* object.


Further, the *Allow saving scene* parameter controls whether the push button will allow only activation of the associated scene, or whether it will also allow saving. If saving of the scene is allowed, then a short press will trigger activation of the scene, while a long press will trigger saving of the scene. If saving of the scene is not allowed, then pressing the button will always activate the scene.

The *Button text* and *Button icon* parameters can be used to set a text label and/or icon to be displayed on the component.

3.4.2.4 Double Push Button

Parameter name	Values
Double push button type	Scene
Left button icon	[Icon selection]
- Icon colour	[Icon colour]
Right button icon	[Icon selection]
- Icon colour	[Icon colour]

Double push buttons provide a pair of buttons (left and right) in a single component. Only the “Scene” type is supported, which is described next.



Scene


Parameter name	Values
Left: Scene number	1 ... 64
Left: Allow saving	No / Yes
Right: Scene number	1 ... 64
Right: Allow saving	No / Yes

Double push buttons of type “Scene” behave exactly in the same way as Scene Push Button components, except that each of the two buttons (left and right) can be individually configured for a different scene.


3.4.2.5 Regulation Bar

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float
Decimal places (Only for “2-byte float” data type)	Automatic / 0 / 1 / 2
Units (Except for “Percentage” data type)	[Text field]
Minimum bar value	[See description]
Maximum bar value	[See description]

Regulation Bars are based on Indicators of type “Level bar”. They display the current value of the associated communication object as a level bar, and their configuration parameters are exactly the same as for the corresponding indicator component.



Additionally, when the component area is pressed, a window will pop up, containing an interactive regulation bar that allows the user to select values to be sent to the bus.

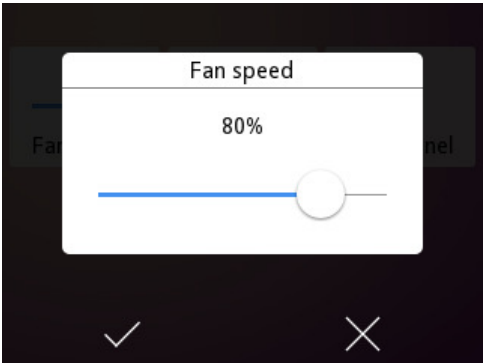

Values are sent to the bus through an additional “control” communication object. Whenever a value is sent to the bus through the “control” object, the indicator display is also updated automatically.


Note

The interactive regulation bar only allows the selection of values within the range configured through the *Minimum bar value* and *Maximum bar value* parameters.


3.4.2.6 Rotary Control

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float
Decimal places (Only for “2-byte float” data type)	Automatic / 0 / 1 / 2
Units (Except for “Percentage” data type)	[Text field]
Minimum dial value	[See description]
Maximum dial value	[See description]

Rotary Controls are based on Indicators of type “Level dial”. They display the current value of the associated communication object as a level dial, and their configuration parameters are exactly the same as for the corresponding indicator component.



Additionally, when the component area is pressed, a window will pop up, containing an interactive rotary control that allows the user to select values to be sent to the bus.

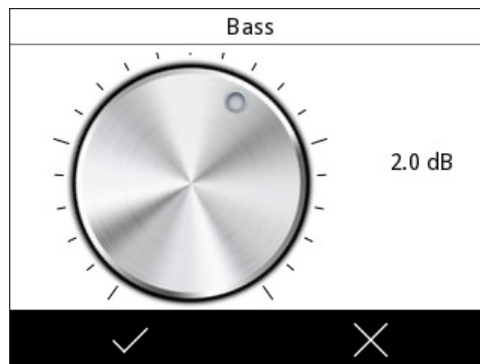

Values are sent to the bus through an additional “control” communication object. Whenever a value is sent to the bus through the “control” object, the indicator display is also updated automatically.


Note

The interactive rotary control only allows the selection of values within the range configured through the *Minimum dial value* and *Maximum dial value* parameters.


3.4.2.7 Numeric Keypad

Parameter name	Values
Data type	1-byte unsigned int 1-byte signed int Percentage 2-byte unsigned int 2-byte signed int 2-byte float
Decimal places (Only for “2-byte float” data type)	Automatic / 0 / 1 / 2
Units (Except for “Percentage” data type)	[Text field]
Minimum input value	[See description]
Maximum input value	[See description]
Error text for invalid input	[Text field]

Numeric Keypads are based on Indicators of type “Numerical”. They display the current value of the associated communication object as a number, and can be configured in a similar way as the corresponding indicator component.



Additionally, when the component area is pressed, a window will pop up, containing an interactive numeric keypad that allows the user to enter values to be sent to the bus.

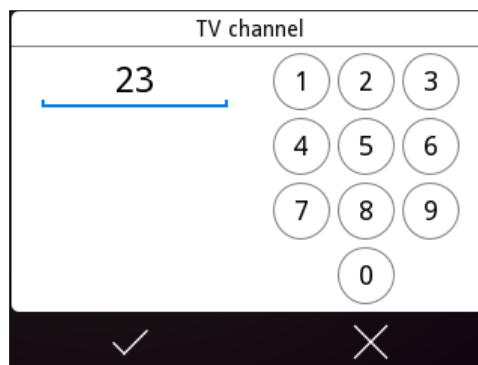

Values are sent to the bus through an additional “control” communication object. Whenever a value is sent to the bus through the “control” object, the indicator display is also updated automatically.

Three additional parameters are defined: The *Minimum input value* and *Maximum input value* parameters limit the range of valid values that can be entered through the numeric keypad. If users enter a value that is outside this range, the value will not be accepted; instead, an error message will be shown. The error text can be customized through the *Error text for invalid input* parameter.

The range of valid values for the *Minimum input value* and *Maximum input value* parameters equals the range of the selected data type. The default value for the parameter will be the minimum or maximum value of the valid range, respectively.

3.4.2.8 Dimmer Control


Parameter name	Values
Dimmer type	Relative dimmer / Absolute dimmer
Action	Left off, right on / Left on, right off
Show status value (Only for relative dimmers)	[Checkbox]
Dimming step (Only for relative dimmers)	100% / 50% / 25% / 12.5% / 6.25% / 3.1% / 1.6%
Left button icon	[Icon selection]
- Icon colour	[Icon colour]
Right button icon	[Icon selection]
- Icon colour	[Icon colour]

Dimmer Controls are specialized components that can be used to control light dimmer actuators.

The following communication objects are available:

- *Dimmer level indicator* (DPT 5.001)
- *Light on/off* (DPT 1.001)
- One of:
 - *Relative dimming control* (DPT 3.007)
 - *Absolute dimming control* (DPT 5.001)

Dimmer controls are represented as double push buttons in the visualisation.



The current light intensity value is displayed as a percentage (0...100%), and is updated whenever a new value is received through the *Dimmer level indicator* communication object.

Some relative dimmers do not provide feedback on the current light intensity. In this case, the status value can be disabled via the *Show status value* parameter.

The left and right buttons are used to switch the light on and off, and to adjust light intensity. The *Action* parameter allows selecting the function of each button (*Left off*, *right on*, or *Left on*, *right off*).

A short press on any of the buttons sends an On / Off command to the bus through the *Light on/off* communication object.

Handling of long presses depends on the type of dimmer being controlled (as defined by the *Dimmer type* parameter).

Relative dimmers


A long press on any of the buttons starts an increase / decrease light intensity operation. A dimming command will be sent to the dimmer actuator through the *Relative dimming control* communication object, requesting that the light intensity is increased (or decreased) by the amount defined by the *Dimming step* parameter. When the button is released, a “stop” command will be sent to the dimmer; if the dimming operation was still in progress, it will be interrupted.

Note

It is common to set the *Dimming step* to 100%. This way, a long press on any of the buttons will initiate a dimming operation which spans the entire dimming range, all the way up to 100% or down to 0%. As soon as the light intensity reaches the desired value, the user can release the button and the dimming operation will be interrupted.

Absolute dimmers

A long press on any of the buttons will bring up a window with a regulation bar. The regulation bar allows precise selection of light intensity values (0...100%). The selected value will be sent to the bus through the *Absolute dimming control* communication object.

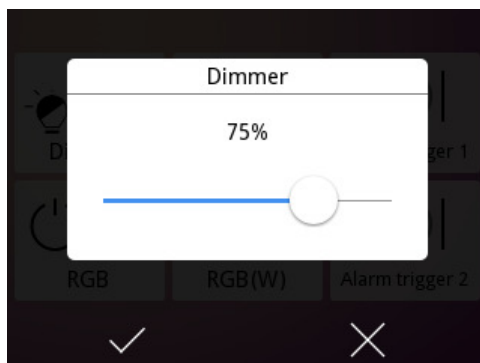

3.4.2.9 Shutter Control


Parameter name	Values
Shutter actuator type	Basic / With absolute positioning
Action	Left down, right up / Left up, right down
Show status value (Only for basic shutters)	[Checkbox]
Left button icon	[Icon selection]
- Icon colour	[Icon colour]
Right button icon	[Icon selection]
- Icon colour	[Icon colour]

Shutter controls are specialized components that can be used to control shutter or blind actuators.

The following communication objects are available:

- *Shutter position indicator* (DPT 5.001)
- *Shutter step/stop* (DPT 1.007)
- One of:
 - *Shutter up/down* (DPT 1.008)
 - *Shutter position control* (DPT 5.001)

Shutter controls are represented as double push buttons in the visualisation.



The current shutter / blind position is displayed as a percentage (0...100%), with 0% corresponding to the “completely open” position, and 100% to the “completely closed” position. This is updated whenever a new value is received through the *Shutter position indicator* communication object.

Some basic shutter actuators do not provide feedback on the current shutter / blind position. In this case, the status value can be disabled via the *Show status value* parameter.

The left and right buttons are used to control the shutter actuator. The *Action* parameter allows selecting the function of each button (*Left down*, *right up*, or *Left up*, *right down*).

A short press on any of the buttons sends a step up or step down command to the bus through the *Shutter step/stop* communication object. If a move operation was in progress, it will be interrupted. Otherwise, a single step operation is performed.


Handling of long presses depends on the type of shutter actuator being controlled (as defined by the *Shutter actuator type* parameter).

Basic shutter actuators

A long press on any of the buttons starts a move up or move down operation through the *Shutter up/down* communication object. This operation will ultimately open or close the shutter completely, unless it is interrupted.

Shutter actuators with absolute positioning

A long press on any of the buttons will bring up a window with a regulation bar. The regulation bar allows precise selection of shutter position values (0...100%). The selected value will be sent to the bus through the *Shutter position control* communication object.

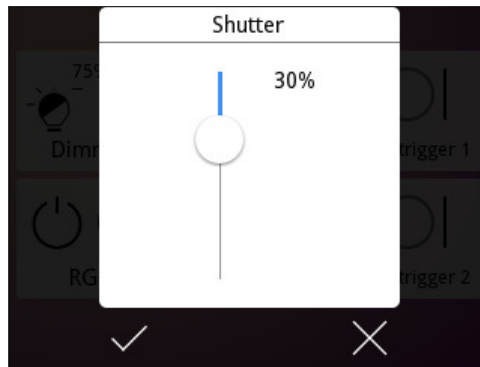

3.4.2.10 RGBW Control

Parameter name	Values
Use white channel	No / Yes
RGB object type	Three separate R,G,B objects (DPT 5.001) One combined RGB object (DPT 232.600)
Left button function	Switch off / Toggle
Left button icon	[Icon selection]
- Icon colour	[Icon colour]

RGBW Controls are specialized components that can be used to control both RGB and RGBW (RGB + White) LED dimmer actuators.

The *RGB object type* parameter sets whether the RGBW control should use three separate 1-byte R, G, B communication objects (one per channel), or one combined 3-byte RGB object.

The *Use white channel* parameter selects whether a white channel should also be controlled, in addition to the Red, Green, and Blue channels. The white channel is controlled through an additional 1-byte object.


Operation

The RGBW Control shows two buttons; an action button (left) and the colour selection button (right):



The function of the action button is configured through the *Left button function* parameter: Either switch all channels off (sets all channels to 0%), or toggle between switching all channels off and recalling the previously selected colour.

The colour selection button shows the current colour. Pressing this button brings up an interactive colour selection window. This allows selecting different colours and sending them to the bus. The user can also save their “favorite” colours for later use. For each RGBW Control, up to ten favorite colours can be saved.

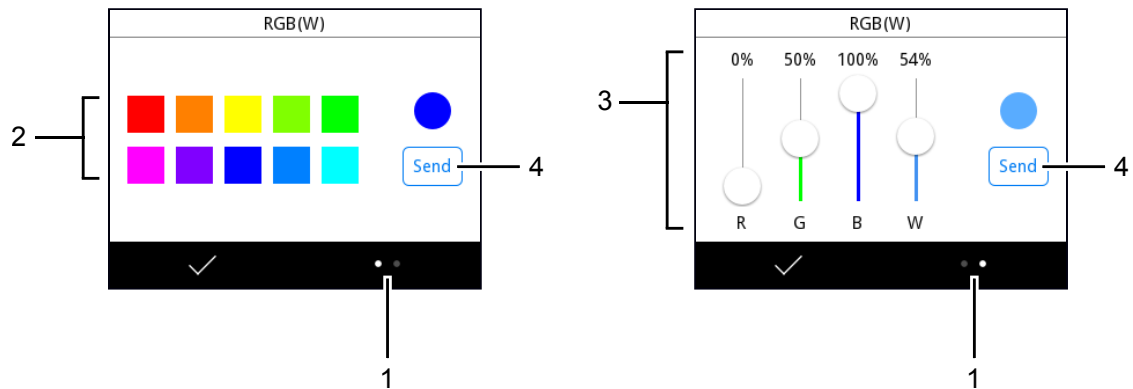

While the colour selection window is open:

- Use the “view switch” button (1) to toggle between the “favorites” and “colour adjustment” views.
- In the colour adjustment view, use the bars (3) to adjust the desired value for each channel.
- In the favorites view, perform a short press on one of the colour swatches (2) to recall the colour stored in that position, and a long press to save the current colour in that position.
- Press the *Send* button (4) to send the current colour to the bus.

3.4.3 Timer function

Parameter name	Values
Enable timer function	[Checkbox]
Add to timer group (Only if timer function is enabled)	None / Group 1 / Group 2 / Group 3 / Group 4

For most components in the visualisation, a timer function can be enabled. When the timer function is enabled for a component, users can setup actions to be run at scheduled times.

The *Enable timer function* checkbox enables the timer function for the component. The *Add to timer group* parameter allows adding a component to one of the four available timer groups. See [2.2 Time schedules](#) on page 21 for a detailed functional description of timers and timer groups.

Note

If timer groups shall be used, make sure to enable the corresponding communication objects. See [3.2.3 Timer groups](#) on page 42.

3.4.3.1 Timer function support

Component type	Timer function support	Additional notes
Indicator	Not applicable	
Indicator with Alarm	Not applicable	
Push Buttons	Yes	See note 1
Double Push Buttons	Yes	
Regulation Bars	Yes	
Rotary Controls	Yes	
Numeric Keypads	Yes	
Dimmer Controls	Yes	See note 2
Shutter Controls	Yes	See note 3
RGBW Controls	Yes	
Setpoint control	Yes	See note 4

Notes:

1. The timer function is supported for the following subtypes:
 - Binary: Send 0 / Send 1 / Toggle
 - Numeric: Send fixed value
 - Choice
 - Scene
2. For absolute Dimmer Controls, the timer function allows scheduling of any dimming action. For relative Dimmer Controls, only on / off actions can be scheduled.

3. For Shutter Controls with absolute positioning, the timer function allows scheduling of any positioning action. For basic Shutter Controls, only simple move up / move down actions can be scheduled.
4. The timer function allows scheduling the sending of the temperature setpoint. Additionally, if the control is configured to allow local On/Off, the sending of a switch-off (Off) command can also be scheduled; and whenever a setpoint is scheduled, a switch-on (On) command is automatically sent first.

3.5 Thermostats

The *Thermostat 1* and *Thermostat 2* configuration sections will be available if the corresponding functions have been enabled in the Main configuration section.

Both thermostats support two configuration modes: “Complete” (more flexible, but also more complex) and “Simplified”.

The remainder of this section describes the parameters corresponding to the complete configuration mode. The simplified configuration mode is described in detail in [3.5.7 Simplified configuration mode](#) on page 82.

For a detailed functional description, see [2.4 Thermostats](#) on page 25.

3.5.1 General

Thermostat function

Parameter name	Values
Configuration	Complete / Simplified
Thermostat function	Heating only / Cooling only / Heating and cooling
Heating / Cooling switching (Only if “Heating and cooling” is selected)	Manual / Automatic
Changeover protection band (Only for Automatic switching of Heating / Cooling)	5 ... 100 (x 0.1°C)
Heating / Cooling mode after programming (Only if “Heating and cooling” is selected)	Heating / Cooling

The *Configuration* parameter selects the configuration mode (complete or simplified).

The *Thermostat function* parameter allows selecting the thermostat function: Heating only, cooling only, or both heating and cooling. Depending on the selected option, additional “Heating” and “Cooling” configuration sections will be enabled.

If “Heating and cooling” is selected, the *Heating / Cooling switching* parameter determines whether switching between heating and cooling will be done manually or automatically.

- Manual switching: Switching is done through a *Heating / Cooling mode* communication object. Writing a “1” to this object switches to Heating mode; writing a “0” switches to Cooling mode.
- Automatic switching: The thermostat automatically manages the changeover between heating and cooling. In this case, the *Changeover protection band* parameter is also enabled. See [2.4.4 Heating and Cooling](#) on page 30 for a detailed description of the automatic switching logic.

In both cases, the current thermostat function (heating or cooling) is available at any time through the *Heating/Cooling mode (status)* communication object.

Also, the *Heating / Cooling mode after programming* parameter defines the initial mode (either “Heating” or “Cooling”) after an ETS download.

Thermostat on/off control

Parameter name	Values
Thermostat always ON	No / Yes
State after bus recovery (Only if thermostat is NOT always ON)	Last state / Off / On
Switch ON upon operating mode reception (Only if thermostat is NOT always ON)	No / Yes

The *Thermostat always ON* parameter determines whether the thermostat should always be on, or whether it should be possible to switch it on and off through an associated communication object.

If the thermostat is NOT always ON:

- Two communication objects are enabled (*On/Off* and *On/Off (status)*) to control operation of the thermostat.

- A parameter *State after bus recovery* is available to define the state of the thermostat at startup, or after a bus recovery event (On, Off, or the last known state)
- A parameter *Switch ON upon operating mode reception* determines if the thermostat should automatically switch on when it receives a request to change the current operating mode, or when it enters “Forced protection” mode via activation of the *Window status* object (if enabled).

Sending of status values

Parameter name	Values
Status sending delay after bus recovery	0 ... 255 (x 1s, 0 = Disabled)

Parameter *Status sending delay after bus recovery* controls whether the initial value of the thermostat’s status objects is sent to the bus at startup or after a bus recovery event. Values can be sent after a configurable delay (1-255 seconds) or this function can be disabled by setting the parameter to 0.

3.5.2 Room Temperature

Parameter name	Values
Room temperature	Temperature Source 1 75% Temp. Source 1 - 25% Temp. Source 2 50% Temp. Source 1 - 50% Temp. Source 2 25% Temp. Source 1 - 75% Temp. Source 2
Temperature Source 1	Internal sensor Temperature Probe IN1 Temperature Probe IN2 Temperature Probe IN3 Temperature Probe IN4 External object
Temperature Source 2 (If enabled)	Internal sensor Temperature Probe IN1 Temperature Probe IN2 Temperature Probe IN3 Temperature Probe IN4

These parameters allow selection of the temperature sources used to measure room temperature. If more than one source is selected, their values can be averaged in a configurable proportion (75% / 25%, 50% / 50%, or 25% / 75%).

For each temperature source it is possible to select the internal temperature sensor, an external temperature probe connected to one of the four available multifunction inputs (IN1...IN4), or (for temperature source 1), an external communication object. If the latter is selected, a communication object *External temperature source* (DPT 9.001) will be enabled for this purpose.

Note

When using an external probe connected to one of the multifunction inputs as a temperature source, make sure to configure the input accordingly.

3.5.3 Setpoints

Parameter name	Values
Setpoint method	Absolute / Relative

The *Setpoint method* parameter determines which method will be used to define setpoints for the thermostat operating modes: Either the Absolute Setpoints method, or the Relative Setpoints method.

See [2.4.3 Setpoints](#) on page 26 for a detailed description of operating modes, absolute setpoints, and relative setpoints.

Absolute Setpoints

Parameter name	Values
Comfort setpoint (heating)	0 ... 22 ... 50 (°C)
Standby setpoint (heating)	0 ... 20 ... 50 (°C)
Economy setpoint (heating)	0 ... 18 ... 50 (°C)
Frost protection setpoint	-10 ... 7 ... 15 (°C)
Comfort setpoint (cooling)	0 ... 24 ... 50 (°C)
Standby setpoint (cooling)	0 ... 26 ... 50 (°C)
Economy setpoint (cooling)	0 ... 28 ... 50 (°C)
Overheating protection setpoint	30 ... 35 ... 100 (°C)
Make setpoint changes permanent	Manually / Upon mode changes / Never

In the Absolute Setpoints method, setpoints for each operating mode are defined as absolute temperature values. Setpoints for the heating function and for the cooling functions can be defined separately, if the thermostat has been setup to operate in both heating and cooling mode.

Relative Setpoints

Parameter name	Values
Base setpoint after programming	0 ... 23 ... 50 (°C)
User offset (min.)	-10 ... -5 ... 0 (°C)
User offset (max.)	0 ... 5 ... 10 (°C)
Comfort offset (heating)	-10 ... -1 ... 0 (°C)
Standby offset (heating)	-10 ... -3 ... 0 (°C)
Economy offset (heating)	-10 ... -5 ... 0 (°C)
Frost protection setpoint	-10 ... 7 ... 15 (°C)
Comfort offset (cooling)	0 ... 1 ... 10 (°C)
Standby offset (cooling)	0 ... 3 ... 10 (°C)
Economy offset (cooling)	0 ... 5 ... 10 (°C)
Overheating protection setpoint	30 ... 35 ... 100 (°C)
Reset user offset on operating mode changes	No / Yes

In the Relative Setpoint method, setpoints for each operating mode (except for the building protection modes) are defined as offsets relative to a common base setpoint.

3.5.4 Operating Modes

Parameter name	Values
1-bit operating mode objects	Disabled / Switch / Trigger
Window status object	Disabled / Enabled

The operating mode of the thermostat (comfort, standby, economy, or building protection) can be changed at any time through the *Operating mode* 1-byte communication object (always available), or through four 1-bit communication objects, one per mode (enabled via the *1-bit operating mode objects* parameter). Additionally, the *Window status* communication object

can be used to enter a “Forced protection” mode, regardless of the current operating mode selected by the user.

3.5.5 Heating

This section is only shown if the thermostat is setup for heating, or for both heating and cooling.

Parameter name	Values
Control method	Two-point control / P-I control

The *Control method* parameter determines the algorithm to use for thermostatic control: Either two-point control with hysteresis (*Two-point control*) or proportional-integral control (*P-I control*). The latter includes both P-I control with continuous output and P-I control with PWM output.

Two-point control

Parameter name	Values
Output type	1 bit / 1 byte (0-100%)
Upper hysteresis	1 ... 10 ... 100 (x 0.1°C)
Lower hysteresis	1 ... 10 ... 100 (x 0.1°C)
Resending period	0 ... 255 (x 1 min, 0 = Disabled)

When the two-point control method is selected, on/off commands are sent through the *Output variable (heating)* communication object. This will be a 1-bit object or a 1-byte object, depending on the setting of the *Output type* parameter.

The meaning of the *upper hysteresis* and *lower hysteresis* parameters is described in detail in section [2.4.5 Control algorithms](#) on page 32.

The value of the communication object may be resent to the bus periodically, according to the *Resending period* parameter. Setting this parameter to 0 disables periodic resending.

P-I control

Parameter name	Values
Output type	Continuous (1 byte) / PWM (1 bit)
Cycle time	1 ... 15 ... 255 (x 1 min)
Control parameters	Custom parameters Warm water heating (5K/150min) Floor heating (5K/240min) Electric heating (4K/100min) Convection heating (4K/90min)
Proportional band (Only if “custom parameters” is selected)	1 ... 4 ... 15 (K)
Integral time (Only if “custom parameters” is selected)	5 ... 150 ... 255 (x 1 min)
Resending period	0 ... 255 (x 1 min, 0 = Disabled)

If the proportional-integral (P-I) control method is selected, control commands will be sent through the *Output variable (heating)* communication object. This will be a 1-bit object or a 1-byte object, depending on the setting of the *Output type* parameter.

For proper operation of the P-I control method, the *Cycle time*, *Proportional band*, and *Integral time* parameters need to be defined. The latter two can be defined explicitly, or (more conveniently) one of the available predefined options may be selected from the *Control parameters* list.

See [2.4.5 Control algorithms](#) on page 32 for a detailed description of all control parameters involved.

Additional heating

Parameter name	Values
Additional heating	No / Yes
Additional heating band (Only if additional heating is enabled)	-100 ... -25 ... -5 (x 0.1°C)
Resending period (Only if additional heating is enabled)	0 ... 255 (x 1 min, 0 = Disabled)

These parameters enable control of auxiliary heating systems. For more information, please refer to [2.4.6 Additional heating and cooling](#) on page 37.

3.5.6 Cooling

This section is only shown if the thermostat is setup for cooling, or for both heating and cooling.

Parameter name	Values
Control method	Two-point control / P-I control
Output objects	Separate heating/cooling objects
<i>(Only if “Heating and cooling” was selected)</i>	Shared heating/cooling object

The available configuration parameters and communication objects are equivalent to the parameters and objects described in the **Heating** configuration section, except that they apply to Cooling mode instead.

If the thermostat is setup for both heating and cooling, the additional *Output objects* parameter determines whether separate communication objects will be used for heating and cooling, or whether a shared object will be used for both modes. By default, separate objects are used. If the “shared object” option is selected, all control values are sent through the *Output variable (heating)* communication object.

3.5.7 Simplified configuration mode

In the simplified configuration mode, the operating modes (Comfort, Standby, Economy, and Protection) and all associated communication objects are disabled. The thermostat always operates in a single mode (equivalent to “Comfort”). The *Window status* object is always enabled; when activated, the thermostat enters the special “Forced protection” mode.

Setpoints are always configured as absolute temperature values. Since operating modes are not available, only the *Initial setpoint* (initial setpoint value after an ETS download) and the Protection setpoints need to be configured.

3.6 Inputs

3.6.1 General

Parameter name	Values
Input 1 type	Disabled Binary - Push button Binary - Switch Temperature probe
Input 2 type	<i>Same options as for Input 1</i>
Input 3 type	<i>Same options as for Input 1</i>
Input 4 type	<i>Same options as for Input 1</i>

Each of the four available multifunction inputs can be configured as a binary input (in either push button or switch/sensor mode) or as a temperature probe input via the corresponding *Input N type* parameter. Depending on the selection, additional parameters will be enabled. These are described in the following sections.

3.6.2 Binary - Push button

Parameter name	Values
Long press time	1 ... 10 ... 50 (x 0.1 s)
Short press action	None Send binary values Dimmer control Shutter control Scene control
Long press action	<i>Same options as for Short press action</i>
Enable locking object	[Checkbox]

Binary inputs in push button mode can trigger different actions for “short press” and “long press” operations. The *Long press time* parameter defines the minimum press time to differentiate between short and long presses.

The specific actions to be triggered are configured with the *Short press action* and *Long press action* parameters. Additional options for each type of action are described next.

The *Enable locking object* checkbox enables an additional communication object that can be used to lock operation of this input. While the input is locked, short and long presses are ignored, and no actions are triggered.

Send binary values

Parameter name	Values
Send value	Send 0 / Send 1 / Toggle

If the “Send binary values” action is selected, a binary value will be sent to the bus when the action is triggered. The *Send value* parameter determines the value to send: This can be 0, 1, or “Toggle” (alternates between 0 and 1).

Dimmer control

Parameter name	Values
Operation	On Off Alternate on/off Brighter Darker Alternate brighter/darker
Dimming step (Only for dimming operations)	100% / 50% / 25% / 12.5% / 6.25% / 3.1% / 1.6%

If the “Dimmer control” action is selected, the *Operation* parameter determines the exact operation to perform: A switching operation (on, off, or alternate between on and off) or a dimming operation (brighter, darker, or alternate between brighter and darker).

For dimming operations, the *Dimming step* parameter determines how much the light intensity should be increased or decreased. When the action is triggered, a dimming command will be sent to the bus requesting that the light intensity is adjusted (increased or decreased) by this amount.

Shutter control

Parameter name	Values
Operation	Move up Move down Alternate move up/down Step up Step down Alternate step up/down

If the “Shutter control” action is selected, the *Operation* parameter determines the exact operation to perform: A move operation (move up, move down, or alternate between move up and move down) or a step operation (step up, step down, or alternate between step up and step down).

Scene control

Parameter name	Values
Scene operation	Recall scene / Save scene
Scene number	1 ... 64

If the “Scene control” action is selected, a scene recall or save request will be sent to the bus through the *Run/save external scene* object when the action is triggered, depending on the *Scene operation* parameter. The *Scene number* parameter selects the scene that will be affected by this operation.

3.6.3 Binary - Switch

Parameter name	Values
Action when contact CLOSES	None / Send 0 / Send 1 / Toggle 0/1
Action when contact OPENS	<i>Same options as for Action when contact CLOSES</i>
Evaluate initial state	No / Yes
Enable locking object	[Checkbox]

Binary inputs in switch/sensor mode can trigger actions when the state of the input changes. A different action (send 0, send 1, or toggle between 0 and 1) can be associated to each state (*Action when contact CLOSES* and *Action when contact OPENS*).

Additionally, the *Evaluate initial state* parameter determines whether the state of the input should be evaluated (and the corresponding action triggered) at application startup time, and also after bus voltage recovery.

The *Enable locking object* checkbox enables an additional communication object that can be used to lock operation of this input. While the input is locked, any changes in the input state are ignored, and no actions are triggered.

3.6.4 Temperature probe

Parameter name	Values
Calibration offset	-50 ... 0 ... 50 (x 0.1°C)
Sending period	0 ... 255 (x 10 s, 0 = Disabled)
Send when change is greater than	0 ... 255 (x 0.1°C, 0 = Disabled)
Alarm function	Disabled High temperature alarm Low temperature alarm High/low temperature alarms
High temperature alarm threshold (If high temperature alarm is enabled)	-30 ... 30 ... 125 (°C)
Low temperature alarm threshold (If low temperature alarm is enabled)	-30 ... 10 ... 125 (°C)

The *Calibration offset*, *Sending period*, and *Send when change is greater than* parameters are equivalent to the corresponding parameters for the internal temperature probe (see [3.2.2 Internal temperature sensor](#) on page 42).

If the temperature cannot be read (for example because the temperature probe is broken, or disconnected from the input) an error is signalled through a separate *[INx] Probe error* communication object.

An alarm function can be enabled to detect high and/or low temperatures. This is done through the *Alarm function* parameter. Also the thresholds for high and low temperature alarms can be defined. The alarm condition is signalled through the *[INx] Temperature alarm* communication object.

Advanced topics

4.1 Product customisation

4.1.1 Background images

The appearance of the user interface of the VERSO Q touch panel can be customized by using custom background images. Custom background images are uploaded to the device through the USB connection.

Background images should be in PNG or JPEG format. Resolution should be 320x240 pixels. File names should be as shown in the following table (if using JPEG images, the extension should be .jpg or .jpeg instead of .png):

File name	Affected pages
home.png	Home page
favs.png	Favorites and Edit favorites pages
page1.png ... page6.png	Control pages 1 ... 6
default.png	Default (all pages)

In order to upload the images to the device:

1. Copy the images to the root directory of a FAT32-formatted USB flash drive.
2. Connect the USB flash drive to the device (use the Iddero USB extension cable, part number E-KUSB1).
3. Go to the System settings page, then select USB > Copy images. The new images will be used immediately.

Installed images can be discarded at any time by selecting USB > Discard installed images.

4.1.2 Custom languages

It is possible to install a custom language file in order to translate any system texts to a new language. Please contact Iddero technical support (support@iddero.com) for further information on this topic.

4.2 Firmware updates

If you need to update the firmware of the VERSO Q touch panel, you can do so through the device's USB connection.

First, you will need to download the firmware release that you want to use. This will typically be a file with `.bin` extension. This file should be copied unmodified to the root directory of a FAT32-formatted USB flash drive. Specifically, do not change the filename, as otherwise it will not be recognized as a valid firmware file.

Connect the USB flash drive to the VERSO Q touch panel (use the Iddero USB extension cable, part number E-KUSB1) and power on (or reboot) the device.

During the boot process, the USB flash drive will be automatically detected, and the firmware update applied. The whole process takes only a few seconds; the device will beep three times once the update is complete, and will boot with the new firmware automatically.

Note

The device will not perform the firmware update if the version of the firmware file found in the USB flash drive matches the version of the currently installed firmware.

You can check the current firmware version at any time in the Info page located in the System Settings menu (see [2.1.6.3 System settings page](#) on page 15).

Annex

5.1 Communication Objects

Miscellaneous

Num.	Name	Type	Flags
1	[Misc] Date	DPT_Date	CT-WU
2	[Misc] Time	DPT_TimeOfDay	CT-WU
3	[Misc] Internal temperature	DPT_Value_Temp	CTR--
4	[Misc] External temperature	DPT_Value_Temp	CT-WU
5	[Misc] Run/save external scene	DPT_SceneControl	CT---
6	[Misc] Wake up	DPT_Trigger	C--W-
9	[Misc] Timer group 1 lock	DPT_Enable	C--W-
10	[Misc] Timer group 2 lock	DPT_Enable	C--W-
11	[Misc] Timer group 3 lock	DPT_Enable	C--W-
12	[Misc] Timer group 4 lock	DPT_Enable	C--W-
13	[Misc] Gesture: Up	DPT_Switch	CT---
15	[Misc] Gesture: Down	DPT_Switch	CT---
17	[Misc] Gesture: Left	DPT_Switch	CT---
19	[Misc] Gesture: Right	DPT_Switch	CT---
21	[Misc] Gesture: Multitouch	DPT_Switch	CT---

Setpoint control

Num.	Name	Type	Flags
42, 78, 114 ... 222	[Cx.T] Setpoint indicator	DPT_Value_Temp	CT-WU
43, 79, 115 ... 223	[Cx.T] Setpoint control	DPT_Value_Temp	CTR--
44, 80, 116 ... 224	[Cx.T] Room temperature indicator	DPT_Value_Temp	CT-WU
45, 81, 117 ... 225	[Cx.T] External On/Off	DPT_Switch	CT-WU
46, 82, 118 ... 226	[Cx.T] On/Off control	DPT_Switch	CTR--
47, 83, 119 ... 227	[Cx.T] Heating/Cooling mode indicator	DPT_Heat_Cool	CT-WU

Components

Num.	Name	Type	Flags
30, 36, 42, 48 ... 240	[Cx.y] Binary indicator	DPT_Switch	CT-WU
	[Cx.y] Enumerated indicator	DPT_Value_1_Ucount	CT-WU
	[Cx.y] 1-byte unsigned int indicator	DPT_Value_1_Ucount	CT-WU
	[Cx.y] 1-byte signed int indicator	DPT_Value_1_Count	CT-WU
	[Cx.y] Percentage indicator	DPT_Scaling	CT-WU
	[Cx.y] 2-byte unsigned int indicator	DPT_Value_2_Ucount	CT-WU
	[Cx.y] 2-byte signed int indicator	DPT_Value_2_Count	CT-WU
	[Cx.y] 2-byte float indicator	DPT 9.xxx	CT-WU
	[Cx.y] 4-byte unsigned int indicator	DPT_Value_4_Ucount	CT-WU
	[Cx.y] 4-byte signed int indicator	DPT_Value_4_Count	CT-WU
	[Cx.y] 4-byte float indicator	DPT 14.xxx	CT-WU
	[Cx.y] Dimmer level indicator	DPT_Scaling	CT-WU
	[Cx.y] Shutter position indicator	DPT_Scaling	CT-WU
	[Cx.y] RGB colour	DPT_Colour_RGB	CTRWU
	[Cx.y] RGB red channel	DPT_Scaling	CTRWU
31, 37, 43, 49 ... 241	[Cx.y] Binary control	DPT_Switch	CTR--
	[Cx.y] Enumerated control	DPT_Value_1_Ucount	CTR--
	[Cx.y] 1-byte unsigned int control	DPT_Value_1_Ucount	CTR--
	[Cx.y] 1-byte signed int control	DPT_Value_1_Count	CTR--
	[Cx.y] Percentage control	DPT_Scaling	CTR--
	[Cx.y] 2-byte unsigned int control	DPT_Value_2_Ucount	CTR--
	[Cx.y] 2-byte signed int control	DPT_Value_2_Count	CTR--
	[Cx.y] 2-byte float control	DPT 9.xxx	CTR--
	[Cx.y] Light on/off	DPT_Switch	CTR--
	[Cx.y] Shutter step/stop	DPT_Step	CT---
	[Cx.y] RGB green channel	DPT_Scaling	CTRWU
	[Cx.y] Alarm trigger	DPT_Alarm	C--WU
32, 38, 44, 50 ... 242	[Cx.y] Relative dimming control	DPT_Control_Dimming	CT---
	[Cx.y] Absolute dimming control	DPT_Scaling	CTR--
	[Cx.y] Shutter up/down	DPT_UpDown	CT---
	[Cx.y] Shutter position control	DPT_Scaling	CTR--
	[Cx.y] RGB blue channel	DPT_Scaling	CTRWU
	[Cx.y] Alarm acknowledge	DPT_Ack	CT-W-
33, 39, 45, 51 ... 243	[Cx.y] White channel	DPT_Scaling	CTRWU

Thermostats

Num.	Name	Type	Flags
606, 641	[Tx] External temperature source	DPT_Value_Temp	CT-WU
607, 642	[Tx] Heating/Cooling mode	DPT_Heat_Cool	C--W-
608, 643	[Tx] Heating/Cooling mode (status)	DPT_Heat_Cool	CTR--
609, 644	[Tx] On/Off	DPT_Switch	C--W-
610, 645	[Tx] On/Off (status)	DPT_Switch	CTR--
611, 646	[Tx] Operating mode	DPT_HVACMode	C--W-
612, 647	[Tx] Operating mode: Comfort (switch)	DPT_Switch	C--W-
612, 647	[Tx] Operating mode: Comfort (trigger)	DPT_Trigger	C--W-
613, 648	[Tx] Operating mode: Standby (switch)	DPT_Switch	C--W-
613, 648	[Tx] Operating mode: Standby (trigger)	DPT_Trigger	C--W-
614, 649	[Tx] Operating mode: Economy (switch)	DPT_Switch	C--W-
614, 649	[Tx] Operating mode: Economy (trigger)	DPT_Trigger	C--W-
615, 650	[Tx] Operating mode: Protection (switch)	DPT_Switch	C--W-
615, 650	[Tx] Operating mode: Protection (trigger)	DPT_Trigger	C--W-
617, 652	[Tx] Window status	DPT_Window_Door	C--W-
618, 653	[Tx] Operating mode (status)	DPT_HVACMode	CTR--
619, 654	[Tx] Setpoint	DPT_Value_Temp	C--W-
619, 654	[Tx] Base setpoint	DPT_Value_Temp	C--W-
620, 655	[Tx] Base setpoint (status)	DPT_Value_Temp	CTR--
621, 656	[Tx] Setpoint offset	DPT_Value_Tempd	C--W-
622, 657	[Tx] Setpoint step	DPT_Step	C--W-
623, 658	[Tx] Setpoint offset (status)	DPT_Value_Tempd	CTR--
624, 659	[Tx] Setpoint (status)	DPT_Value_Temp	CTR--
625, 660	[Tx] Reset setpoints	DPT_Reset	C--W-
625, 660	[Tx] Reset offset	DPT_Reset	C--W-
626, 661	[Tx] Save setpoint	DPT_Trigger	C--W-
627, 662	[Tx] Output variable (heating)	DPT_Switch	CTR--
627, 662	[Tx] Output variable (heating)	DPT_Scaling	CTR--
628, 663	[Tx] Output variable (cooling)	DPT_Switch	CTR--
628, 663	[Tx] Output variable (cooling)	DPT_Scaling	CTR--
629, 664	[Tx] Additional heating	DPT_Switch	CTR--
630, 665	[Tx] Additional cooling	DPT_Switch	CTR--

Multifunction inputs

Num.	Name	Type	Flags
676, 682, 688, 694	[INx] Short press: Binary value	DPT_Switch	CT---
	[INx] Short press: Light on/off	DPT_Switch	CT---
	[INx] Short press: Dimmer control	DPT_Control_Dimming	CT---
	[INx] Short press: Shutter up/down	DPT_UpDown	CT---
	[INx] Short press: Shutter step/stop	DPT_Step	CT---
	[INx] Output value	DPT_Switch	CTR--
	[INx] Current temperature	DPT_Value_Temp	CTR--
677, 683, 689, 695	[INx] Long press: Binary value	DPT_Switch	CT---
	[INx] Long press: Light on/off	DPT_Switch	CT---
	[INx] Long press: Dimmer control	DPT_Control_Dimming	CT---
	[INx] Long press: Shutter up/down	DPT_UpDown	CT---
	[INx] Long press: Shutter step/stop	DPT_Step	CT---
	[INx] Probe error	DPT_Alarm	CTR--
678, 684,	[INx] Input lock	DPT_Switch	C--W-
690, 696	[INx] Temperature alarm	DPT_Alarm	CTR--

IDDERO

Av. Juan López Peñalver, 21
Parque Tecnológico de Andalucía
29590 Málaga, Spain
support@iddero.com
www.iddero.com

© 2026 INGELABS, S.L. All rights reserved.

Iddero is a registered trademark of INGELABS, S.L. KNX is a registered trademark of the KNX Association cvba. All other product, service, and company names may be trademarks or registered trademarks of their respective owners.

IMPORTANT: Only qualified electricians should install, service, or manipulate this equipment. Existing regulations for the prevention of accidents must be observed, as well as any national or local codes and regulations and standard safety precautions.

All information in this manual is provided “as is” without warranty of any kind, either express or implied, including, but not limited to implied warranties of merchantability or fitness for a particular purpose. Every effort has been made to ensure that the information in this manual is accurate; however this document may contain technical inaccuracies, typographical, or other errors. INGELABS, S.L. assumes no liability for any errors in this document, and for damages, whether direct, indirect, incidental, and consequential or otherwise, that may result from such error, including, but not limited to loss of data or profits. Product specifications are subject to change without notice.